

E

Sound

Building Regulations 2014

Technical Guidance Document



Comhshaol, Pobal agus Rialtas Áitiúil
Environment, Community and Local Government



Building Regulations 2014

Technical Guidance Document E

Sound

BAILE ÁTHA CLIATH
ARNA FHOILSIÚ AG OIFIG AN tSOLÁTHAIR
Le ceannach díreach ó
FOILSEACHÁIN RIALTAIS,
52 FAICHE STIABHNA, BAILE ÁTHA CLIATH 2
(Teil: 01 – 6476834 nó 1890 213434; Fax 01 – 6476843)

DUBLIN
PUBLISHED BY THE STATIONERY OFFICE
To be purchased from
GOVERNMENT PUBLICATIONS,
52 ST. STEPHEN'S GREEN, DUBLIN 2.
(Tel: 01 – 6476834 or 1890 213434; Fax: 01 – 6476843)

Price €8.00

ISBN 9781406428728



Printed on recycled paper containing a
minimum of 75% post-consumer waste



Comhshaol, Pobal agus Rialtas Áitiúil
Environment, Community and Local Government

© Government of Ireland 2014

Contents

	Page
Introduction	5
Transitional arrangements	5
The guidance	5
Existing buildings	5
Technical specifications	6
Materials and workmanship	6
Interpretation	6
Part E - The requirement	7
Section 0: General guidance	8
0.1 Application of Part E	8
0.1.1 General	8
0.1.2 Guidance	9
0.1.3 Definitions	9
0.2 Sound	11
0.2.1 General	11
0.2.2 Direct transmission of sound	11
0.2.3 Flanking transmission of sound	12
0.3 Other design considerations	12
0.3.1 General	12
0.3.2 Room layout and building services	13
Section 1: Performance	14
1.1 Performance	14
1.1.1 General	14
1.1.2 Compliance method	14
1.1.3 Protected structures	14
Section 2: Testing	16
2.1 Testing	16
2.1.1 General	16
2.1.2 Competency of tester	16
2.1.3 Requirements for testing	16
2.1.4 Establishing the appropriate amount of testing required	16
2.1.5 Sets of tests	17
2.2 Programme of testing	18
2.2.1 General	18
2.2.2 Initial testing	18
2.2.3 Minimum frequency of testing	18
2.2.4 Reporting procedure	18
2.2.5 Actions following a failed set of tests	18

2.3	Assessed Sound Details (ASDs)	19
2.3.1	General	19
2.4	Other Constructions	19
2.4.1	General	19
Section 3: Separating walls and associated flanking construction details		20
3.1	Separating wall construction	20
3.1.1	General	20
3.1.2	Types of wall	20
3.2	Flanking provisions	21
3.2.1	General	21
3.2.2	Junctions between separating walls and other building elements	21
3.2.3	Corridor walls	21
3.2.4	Entrance doors opening onto a common area of a building	21
3.2.5	Noise from services	21
3.3	Wall Type 1 (WT 1) - Solid masonry / concrete with plaster finish	23
3.3.1	General	23
3.3.2	Wall specification	23
3.3.3	Key junctions and flanking details	23
3.4	Wall Type 2 (WT 2) - Solid masonry with dry lining	27
3.4.1	General	27
3.4.2	Wall specification	27
3.4.3	Key junctions and flanking details	27
3.5	Wall Type 3 (WT 3) - Cavity masonry with plaster finish	31
3.5.1	General	31
3.5.2	Wall specification	31
3.5.3	Key junctions and flanking details	31
3.6	Wall Type 4 (WT 4) - Timber framed wall with absorbent material	35
3.6.1	General	35
3.6.2	Wall specification	35
3.6.3	Key junctions and flanking details	35
Section 4: Separating floors and associated flanking construction details		47
4.1	Separating floor construction	47
4.1.1	General	47
4.1.2	Types of floor	47
4.2	Flanking provisions	48
4.2.1	General	48
4.2.2	Junctions between separating floors and other building elements	48

4.3	Ceiling treatments	48
4.3.1	General	48
4.3.2	Example ceiling treatment for a concrete separating floor	48
4.3.3	Example ceiling treatments for a timber separating floor	48
4.4	Floor treatments	49
4.4.1	General	49
4.4.2	Resilient material	49
4.4.3	Impact sound reduced at source for FT 1 concrete separating floors	49
4.4.4	Floating floors	49
4.4.5	Example floating floor suitable for use with a FT 2 concrete separating floor	49
4.4.6	Example floating floor suitable for use with timber base separating floor	50
4.5	Performance based approach	51
4.5.1	General	51
4.6	Floor Type 1 (FT 1) - Resilient material bonded to concrete base with ceiling under	52
4.6.1	General	52
4.6.2	Floor specification	52
4.6.3	Key junctions and flanking details	52
4.7	Floor Type 2 (FT 2) – Floating layer on concrete base with ceiling under	58
4.7.1	General	58
4.7.2	Floor specification	58
4.7.3	Key junctions and flanking details	58
4.8	Floor Type 3 (FT 3) – Floating layer on timber base with ceiling under	64
4.8.1	General	64
4.8.2	Floor specification	64
4.8.3	Key junctions and flanking details	64
Section 5: Reverberation control		69
5.1	Reverberation control	69
5.1.1	General	69
5.1.2	Common spaces	69
5.1.3	Choice of material	69
5.2	Methods of satisfying the requirement of Regulation E2	69
5.2.1	General	69
5.2.2	Method A	69
5.2.3	Method B	70
5.3	Report Format	70
5.3.1	General	70

Appendix A: Procedure for sound insulation testing and reporting	71
Appendix B: Assessed Sound Details	75
Appendix C: Reverberation control - Method B calculation	77
Referenced standards and publications	81
Other standards and publications	82

Building Regulations 2014

Technical Guidance Document E

Sound

Introduction

This document has been published by the Minister for the Environment, Community and Local Government, under article 7 of the Building Regulations 1997. It provides guidance in relation to Part E of the Second Schedule to the Regulations. The document should be read in conjunction with the Building Regulations 1997-2014, and other documents published under these Regulations. In general, Building Regulations apply to the construction of new buildings and to extensions and material alterations to buildings. In addition, certain parts of the Regulations apply to existing buildings where a material change of use takes place. Otherwise, Building Regulations do not apply to buildings constructed prior to 1 June 1992.

Transitional arrangements

In general, this document applies to works, or buildings in which a material change of use takes place, where the works or the change of use commence or takes place, as the case may be on or after 1 July 2015. Technical Guidance Document E – Sound dated 1997, also ceases to have effect from that date.

The guidance

The materials, methods of construction, standards and other specifications (including technical specifications) which are referred to in this document are those which are likely to be suitable for the purposes of the Regulations. Where works are carried out in accordance with the guidance in this document, this will, prima facie, indicate compliance with Part E of the Second Schedule to the Building Regulations. However, the adoption of an approach other than that outlined in the guidance is not precluded provided that the relevant requirements of the Regulations are complied with. Those involved in the design and construction of a building may be required by the relevant building control authority to provide such evidence as is necessary to establish that the requirements of the Building Regulations are being complied with.

Existing buildings

In the case of material alterations or changes of use of existing buildings, the adoption without modification of the guidance in this document may not, in all circumstances, be appropriate. In particular, the adherence to guidance, including codes, standards or technical specifications, intended for application to new work may be unduly restrictive or impracticable. Buildings of architectural or historical interest are especially likely to give rise to such circumstances. In these situations, alternative approaches based on the principles contained in the document may be more relevant and should be considered.

Technical specifications

Building Regulations are made for specific purposes, e.g. to provide, in relation to buildings, for the health, safety and welfare of persons, the conservation of energy and access for people with disabilities. Technical specifications (including harmonised European Standards, European Technical Assessments, National Standards and Agrément Certificates) are relevant to the extent that they relate to these considerations. Any reference to a technical specification is a reference to so much of the specification as is relevant in the context in which it arises. Technical specifications may also address other aspects not covered by the Regulations. A reference to a technical specification is to the latest edition (including any amendments, supplements or addenda) current at the date of publication of this Technical Guidance Document. However, if this version of the technical specification is subsequently revised or updated by the issuing body, the new version may be used as a source of guidance provided that it continues to address the relevant requirements of the Regulations.

A list of other standards and publications that deal with matters relating to this Part of the Building Regulations is included at the end of this document. These standards and publications may be used as a source of further information but do not form part of the

guidance.

Materials and workmanship

Under Part D of the Second Schedule to the Building Regulations, building work to which the Regulations apply must be carried out with proper materials and in a workmanlike manner. Guidance in relation to compliance with Part D is contained in Technical Guidance Document D.

Interpretation

In this document, a reference to a section, sub-section, part, paragraph or diagram is, unless otherwise stated, a reference to a section, sub-section, part, paragraph or diagram, as the case may be, of this document. A reference to another Technical Guidance Document is a reference to the latest edition of a document published by the Department of the Environment, Community and Local Government, under article 7 of the Building Regulations, (as amended). Diagrams are used in this document to illustrate particular aspects of construction - they may not show all the details of construction.

Sound

Part E - The requirement

Part E of the Second Schedule to the Building Regulations 1997 to 2014, provides as follows: -

Sound.	E1	Each wall and floor separating a dwelling from - (a) another dwelling or dwellings, (b) other parts of the same building, (c) adjoining buildings, shall be designed and constructed in such a way so as to provide reasonable resistance to sound.
Reverberation.	E2	The common internal part of a building which provides direct access to a dwelling shall be designed and constructed so as to limit reverberation in the common part to a reasonable level
Definitions for this Part.	E3	In this Part – “Reverberation” means the persistence of sound in a space after a sound source has been stopped.

Section 0

General guidance

0.1 Application of Part E

thereof) becoming used as one or more dwellings.

0.1.1 General

0.1.1.1 The aim of Part E of the Second Schedule to the Building Regulations is to ensure that dwellings achieve reasonable levels of sound insulation from sound transmission emanating from adjoining buildings or differently occupied parts of the same building.

0.1.1.4 The purpose of the requirement of Regulation E1 is to protect occupants from airborne and impact noise generated in and around dwellings. Diagram 1 illustrates the relevant location of walls and floors which are required to have reasonable sound insulation in order to satisfy the requirement of Regulation E1.

0.1.1.2 For the purposes of Part E of the Second Schedule of the Building Regulations (as amended), the types of sound to be considered are airborne and impact sounds and sound arising from reverberation.


0.1.1.5 The purpose of the requirement of Regulation E2 is to protect occupants from noise produced from reverberation in common internal areas which provide direct access to a dwelling or dwellings.

0.1.1.3 The Requirements of Part E apply to:

- (a) new dwellings and extensions to dwellings which adjoin other buildings, and
- (b) works, involving a material change of use that result in a building (or part

0.1.1.6 Part E does not address environmental noise through the building facade from external sources such as aircraft, trains, road traffic or industry.

Diagram 1 Scope of requirement of Regulation E1
(Par. 0.1.1.4)

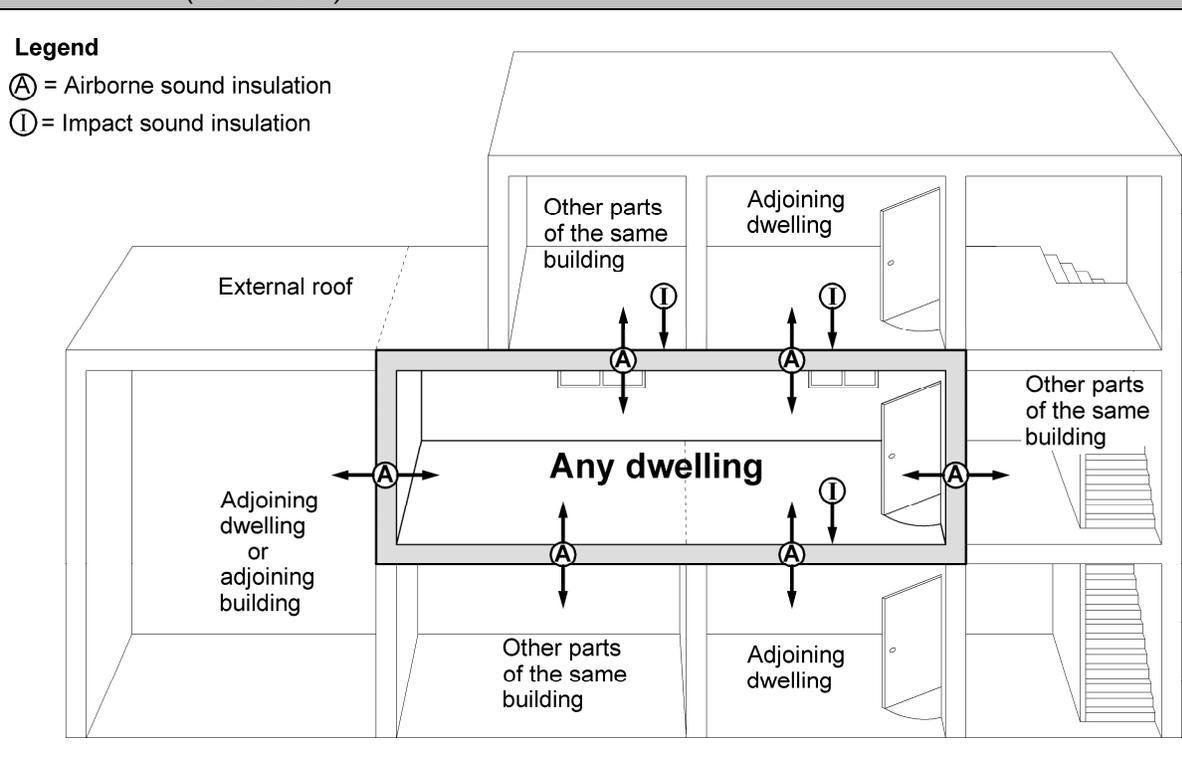

0.1.3 Guidance

0.1.3.1 This document applies to dwellings and some common areas of buildings providing direct access to dwellings. It gives guidance in relation to the achievement of reasonable sound insulation insofar as it relates to non-complex buildings of normal design and construction. Specialist advice may be needed in certain situations to establish if a higher standard of sound insulation is required and, if so, to determine the appropriate level.

0.1.3.2 This Technical Guidance Document is divided into six sections.

Section 0 provides general information on sound.

Section 1 relates to the performance level required to meet the requirement of Regulation E1.

Section 2 provides guidance on testing as a means of demonstrating that the construction complies with the requirement of Regulation E1.

Section 3 provides examples of wall types which, if constructed correctly, should achieve the performance level set out in Section 1.

Section 4 provides examples of floor types which, if constructed correctly, should achieve the performance level set out in Section 1.

Section 5 provides guidance on the control of reverberation in certain common internal parts of buildings and relates to the requirement of Regulation E2.

0.1.3.3 It is important to recognise that the guidance in this document will not guarantee freedom from unwanted sound transmission. The aim of the guidance is to limit the effects from sound levels created from normal domestic activities, but not from excessive noise from other sources such as power tools, audio systems inconsiderately played at high volume or even raised voices.

0.1.4 Definitions

0.1.4.1 For the purposes of this document, the following terms and definitions apply:

Absorption - Conversion of sound energy to heat, often by the use of a porous material.

Absorption coefficient - A quantity characterising the effectiveness of a sound absorbing surface. The proportion of sound energy absorbed is given as a number between zero (for a fully reflective surface) and one (for a fully absorptive surface).

NOTE: *Sound absorption coefficients determined from laboratory measurements may have values slightly larger than one. Refer to I.S. EN ISO 354.*

Absorptive material - Material that absorbs sound energy.

Airborne sound - Sound which is propagated from a noise source through the medium of air, e.g. speech and sound from a television.

Airborne sound insulation - Sound insulation that reduces transmission of airborne sound between buildings or parts of buildings.

Air path - A direct or indirect air passage from one side of a structure to the other.

Cavity stop - A proprietary product or material such as mineral wool used to close the gap in a cavity wall to minimise flanking sound transmission along the wall cavity.

Cavity barrier - A construction provided to close a concealed space against penetration of smoke or flame, or provided to restrict the movement of smoke or flame within such a space (refer to TGD B – Fire Safety).

Decibel (dB) - The unit used for many acoustic quantities to indicate the level with respect to a reference level.

Density - Mass per unit volume, expressed in kilograms per cubic metre (kg/m³).

Direct transmission - Refers to the path of either airborne or impact sound through elements of construction.

DnT - The difference in sound level between a pair of rooms, in a stated frequency band, corrected for the reverberation time. Refer to I.S. EN ISO 16283-1.

DnT,w - The weighted standardised level difference. A single number quantity (weighted) which characterises the airborne sound insulation between rooms in accordance with I.S. EN ISO 717-1.

Dynamic stiffness - A parameter used to describe the ability of a resilient material or wall tie to transmit vibration. Specimens with high dynamic stiffness (dynamically 'stiff') transmit more vibration than specimens with low dynamic stiffness (dynamically 'soft'). Refer to I.S. EN 29052-1 for resilient materials. See BRE Information Paper IP 3/01 for wall ties.

Flanking element - Any building element that contributes to sound transmission between rooms in a building that is not a separating floor or separating wall.

Flanking transmission - Sound transmitted between rooms via flanking elements instead of directly through separating elements or along any path other than a direct path.

Floating floor - A floating floor consists of a floating layer and resilient layer (see also floating layer and resilient layer).

Floating layer - A surface layer that rests on a resilient layer and is isolated from the base floor and the surrounding walls (see also resilient layer).

Frequency - The number of pressure variations (or cycles) per second that gives a sound its distinctive tone. The unit of frequency is the Hertz (Hz).

Frequency band - A continuous range of frequencies between stated upper and lower limits (see also octave band and one-third

octave band).

Hertz (Hz) - The unit of frequency of a sound (cycles per second).

Impact sound - Sound resulting from direct impact on a building element.

Impact sound insulation - Sound insulation which reduces impact sound transmission from direct impacts such as footsteps on a building element.

Internal floor - Any intermediate floor within a dwelling.

Intermediate landing - A landing between two floors (see also landing).

Internal wall - Any wall within a dwelling that does not have a separating function.

Isolation - The absence of rigid connections between two or more parts of a structure.

Landing - A platform or part of a floor structure at the top or bottom of a flight of stairs or ramp.

L'_{nT} - The impact sound pressure level in a stated frequency band, corrected for the reverberation time. See I.S. EN ISO 140-7¹.

L'_{nT,w} - The weighted standardised impact sound pressure level. A single-number quantity (weighted) to characterise the impact sound insulation of floors, in accordance with I.S. EN ISO 717-2.

Mass per unit area - An expression in terms of kilograms per square metre (kg/m²).

Noise - Unwanted sound.

Octave band - A frequency band in which the upper limit of the band is twice the frequency of the lower limit.

One - third octave band - A frequency band

¹ I.S. EN ISO 16283-2 should be used when published

in which the upper limit of the band is $2^{1/3}$ times the frequency of the lower limit.

R_w - A single number quantity (weighted) which characterises the airborne sound insulation of a building element from measurements undertaken in a laboratory, in accordance with I.S. EN ISO 717-1.

Resilient layer - A layer that isolates a floating layer from a base.

Resilient material - A material which returns to its original thickness after it has been compressed.

Resonance – increased amplitude of oscillation of an object when it is subjected to vibration from another source at or near its own natural frequency.

Reverberation - The persistence of sound in a space after a sound source has been stopped.

Reverberation time - The time, in seconds, taken for the sound to decay by 60 dB after a sound source has been stopped.

Separating floor - A floor that separates a dwelling from an adjoining dwelling or another part of the same building.

Separating wall - A wall that separates a dwelling from an adjoining dwelling, another part of the same building or from an adjoining building.

Sound pressure level - A quantity related to the physical intensity of a sound.

Sound reduction index (R) - A quantity, measured in a laboratory, which characterises the sound insulating properties of a material or building element in a stated frequency band. Refer to I.S. EN ISO 10140-1 to 5.

Spectrum - The composition of a particular sound in terms of separate frequency bands.

Structure-borne sound - Sound which is

carried via the structure of a building.

ΔL_w - The measured improvement of impact sound insulation resulting from the installation of a floor covering or floating floor on a test floor in a laboratory (See I.S. EN ISO 717-2).

0.2 Sound

0.2.1 General

0.2.1.1 Sound is a form of energy which can be transmitted over a distance from its source through a medium, such as air or a solid element of construction, e.g. a wall or a floor. Sound may be transmitted directly or indirectly (flanking transmission). See Diagram 2.

0.2.1.2 The principle methods of isolating the receiver from the source of the sound are:

- (a) eliminating pathways along which the sound can travel, and
- (b) using barriers formed of materials of sufficiently high mass which will not easily vibrate.

In practice, sound insulation is usually achieved by using a combination of both methods described above.

0.2.2 Direct transmission of sound

0.2.2.1 Direct transmission means the transmission of sound directly through a wall or a floor from one of its sides to the other.

0.2.2.2 When sound waves strike a wall or floor, the pressure variations cause the construction to vibrate. A portion of the vibrational energy on the sound source side will be transferred through the wall or floor where it is radiated as airborne sound on the other side.

0.2.2.3 The reduction in the level of airborne sound transmitted through a solid masonry wall depends on the mass of the wall. If the wall is heavy, it is not easily set into vibration. Walls comprising of two or three leaves

depend partly on their mass and partly on structural isolation between the leaves.

0.2.2.4 With masonry walls, the mass is the main factor but stiffness and damping (which turns sound energy into heat) are also important. Cavity masonry walls need at least as much mass as solid walls because their lower degree of stiffness offsets the benefits of isolation.

0.2.2.5 Floors should reduce airborne sound and also, if they are above another dwelling, impact sound.

0.2.2.6 Impact noise is sound that is spread from an impact or vibrational source in direct contact with a building element such as a floor. A structural vibration is transmitted from the point of impact through the structure setting the surface into vibration leading to the radiation of the sound. In a building this is commonly caused by an object hitting the floor from where the vibration is transferred into the structure. Usually the vibration path will lead to the ceiling and perimeter walls. The amount of impact noise heard below will depend upon many factors including the force of the impact, the vibration transmission characteristics of the floor construction and the floor covering.

0.2.2.7 A heavy solid floor depends on its mass to reduce airborne sound and on a resilient layer to reduce impact sound at source. A floating floor uses a resilient layer to isolate the walking surface from the base and this isolation contributes to both airborne and impact sound insulation. The resilient layer is only effective if it is not too stiff and so it is important to choose a suitable material and to make sure that it is not bypassed with rigid bridges such as fixings and pipes (see paragraph 4.4).

0.2.2.8 Air paths must be avoided – porous materials and gaps at joints in the structure must be sealed. Resonances must be avoided; these may occur if some part of the structure (such as dry lining) vibrates strongly at a particular sound frequency (pitch) and transmits more energy at this pitch.

0.2.3 Flanking transmission of sound

0.2.3.1 Flanking transmission means the indirect transmission of sound from one side of a wall or floor to the other side.

0.2.3.2 Because a solid element may vibrate when exposed to sound waves in the air, it may cause sound waves in the air on both sides. Flanking transmission happens when there is a path along which sound can travel between elements on opposite sides of a wall or floor. This path may be through a continuous solid structure or through an air space (such as a cavity of an external wall). Usually, paths through a structure require greater consideration with solid masonry elements, while paths through an air space require greater consideration with thin panels (such as studwork and ceilings) in which structural waves do not travel as freely.

0.2.3.3 The junction of a sound resisting element and a flanking element provides resistance to structural waves, but it may not be enough unless the flanking element is heavy or is divided by windows or similar openings into small sections which do not vibrate freely. Usually a minimum mass is also needed for thin panels connected by paths through air spaces (such as ceilings connected by air in roof spaces and over the ridge of the separating wall). The mass which is required will be less if the path is blocked by non-porous material.

0.3 Other design considerations


0.3.1 General

0.3.1.1 In addition to the importance of construction details and workmanship, other considerations such as the layout of rooms in a dwelling or the presence of steps or staggers between dwellings and adjoining dwellings or buildings are important factors to be considered.

0.3.2.2 Additional guidance is provided in BS 8233 Sound Insulation and noise reduction for buildings - Code of practice and sound control for homes.

0.3.2 Room layout and building services

0.3.2.1 Internal noise levels are affected by room layout. The layout should be considered at the design stage to avoid placing noise sensitive rooms next to rooms in which noise is generated where possible.

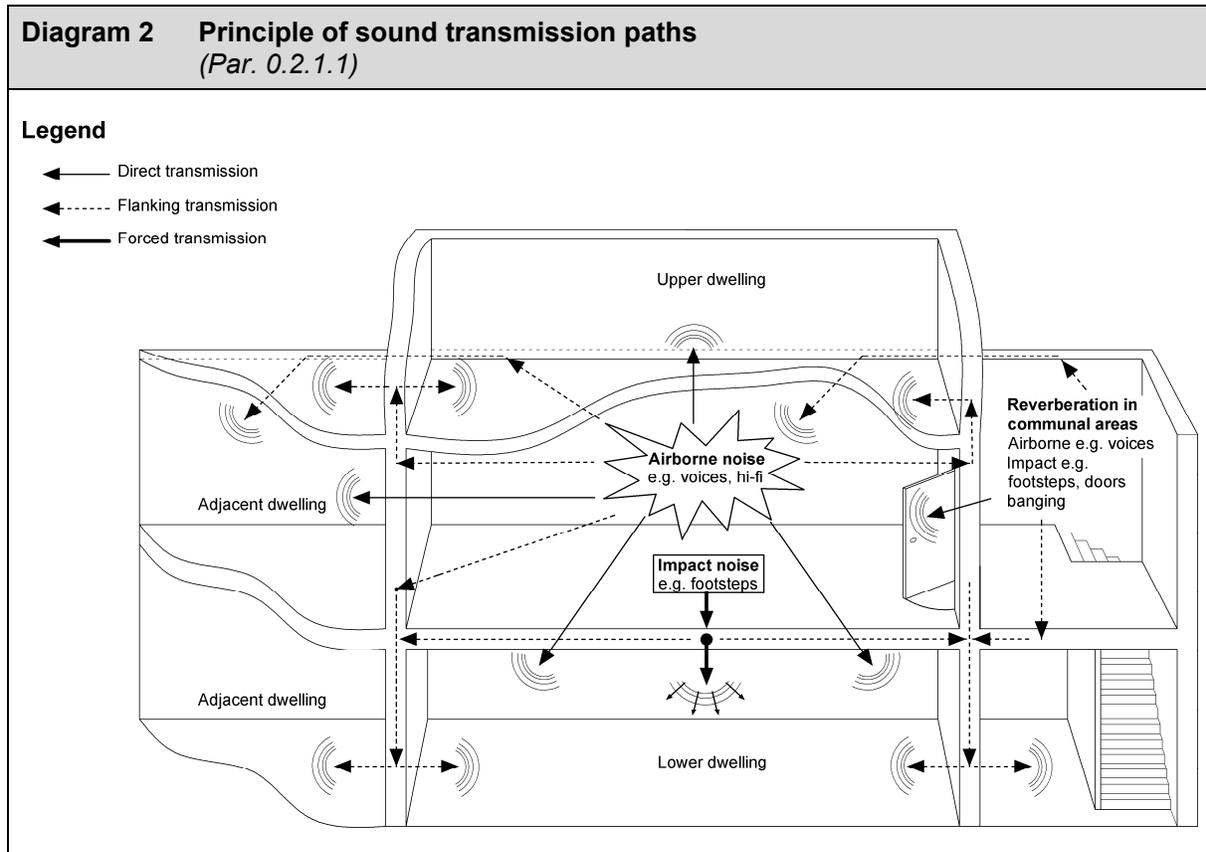

Section 1

Performance

1.1 Performance

1.1.1 General

1.1.1.1 This section provides guidance relating to the performance level required to meet Regulation E1.

1.1.2.1 In general for dwellings, the performance required by Regulation E1 should be satisfied by achieving the sound insulation performance levels as specified in Table 1 below.

Table 1 Sound performance levels (Par. 1.1.1)		
Separating construction	Airborne sound insulation $D_{nT,w}$ dB	Impact sound insulation $L'_{nT,w}$ dB
Walls	53 (min)	-
Floors (including stairs with a separating function)	53 (min)	58 (max)
NOTE: For works to protected structures, refer to paragraph 1.1.3		

1.1.2 Compliance method

1.1.2.1 The sound insulation values set out in Table 1 are for walls and floors that separate spaces used for normal domestic purposes.

1.1.2.2 For new dwellings, where the relevant walls and floors are:

- a) designed and constructed using acceptable constructions in accordance with Sections 3 and 4, and
- b) demonstrated by testing in accordance with Section 2 to meet the performance levels of Table 1,

this will, *prima facie*, indicate compliance with the requirement of Regulation E1.

1.1.2.3 For new dwellings / extensions to dwellings, adjoining an existing building, where the relevant walls and floors are

designed and constructed using acceptable constructions in accordance with Sections 3, this will, *prima facie*, indicate compliance with the requirement of Regulation E1.

1.1.2.4 A higher standard of sound insulation may be required between spaces used for normal domestic purposes and communal or non-domestic purposes. In these situations the appropriate level of sound insulation will depend on the noise generated in the communal or non-domestic space. Specialist advice may be needed to establish if a higher standard of sound insulation is required in order to achieve a reasonable resistance to sound.

1.1.2.5 Protected structures include buildings that have been identified as having particular cultural significance and heritage value and are included by each Planning Authority on a Record of Protected Structures. Protected structures may require special consideration, see paragraph 1.1.3.

1.1.3 Protected structures

1.1.3.1 Protected structures will, prior to conversion, display unique characteristics as far as sound insulation is concerned. The original building design and construction, and any subsequent alterations, will influence the level of sound insulation achievable for any separating walls and separating floors. For this reason, the adoption without modification of standard solutions may not always be appropriate.

1.1.3.2 In the case of material alterations or changes of use to protected structures, the recommended approach is as follows:

- (i) An acoustic assessment of the existing structure should be carried out, including a sound insulation test in accordance with Section 2. This should enable the acoustic performance of the existing construction to be established. The design and construction of the existing structure should also be established
- (ii) Expert acoustic advice should be sought

on appropriate solutions to improve the sound insulation without damaging or creating the potential for damage to the character and special interest of the building.

1.1.3.3 In certain circumstances, achieving the sound insulation standards set out in Table 1 may not be practicable for protected structures. However, the aim should be to improve the sound insulation value as much as practicably possible. Such improvements should not be to the detriment of the character and special interest of the protected structure or contravene any specific planning condition prohibiting modification of an identified existing feature. In such cases, a dispensation or relaxation (or partial dispensation or relaxation) of the Requirements may be granted by the local Building Control Authority.

Section 2

Testing

2.1 Testing

2.1.1 General

2.1.1.1 This section provides guidance on an appropriate program of sound insulation testing to be carried out on site on a proportion of as-constructed dwellings in order to demonstrate compliance with the requirement of Regulation E1.

2.1.2 Competency of tester

2.1.2.1 To ensure a proper standard of testing, it is essential that persons are competent in the measurement of sound insulation in buildings² possess sufficient training, experience and knowledge appropriate to the nature of the work he or she is required to perform having particular regard to the size and complexity of such works.

2.1.3 Requirements for testing

2.1.3.1 Testing should be carried out for:

- (a) new dwellings, and
- (b) works involving a material change of use that results in a building (or part thereof) becoming used as one or more dwellings.

2.1.3.2 The sound insulation tests should be carried out once the dwellings either side of a separating element are essentially complete, except for decoration.

2.1.3.3 The performance levels that should be demonstrated by testing are set out in Table 1.

2.1.3.4 Testing should be carried out on a proportion of dwellings on development sites as part of the construction process (see paragraph 2.2) in accordance with the procedure set out in Appendix A.

² Sound insulation tests carried out by a person certified by an independent third party to carry out this work offers a way of ensuring that such certification can be relied upon.

2.1.3.5 Sound insulation tests should be carried out between rooms or spaces that share a common area of separating wall or separating floor.

2.1.3.6 Impact sound insulation tests should be carried out without a soft covering³ (e.g. carpet, foam backed vinyl) on the floor. Where a resilient material is being used on the surface of the floor, it should be bonded to the floor prior to testing. For further information on impact sound insulation testing see Appendix A.

2.1.3.7 Sound insulation testing does not need to be carried out between the dwelling space and common circulation areas as testing between such spaces may give unreliable results due to the possible complex shape of the circulation spaces, and the possible difficulty of establishing the volume of a circulation space. However, compliance can be demonstrated by inference (by means of similar construction), i.e. that the sound insulation performance of the construction type of walls or floors at these interfaces is at least equivalent to that of the separating wall or floor respectively between the dwellings.

2.1.3.8 While only a proportion of dwellings must be tested, all separating walls or separating floors, subject to the requirement of Regulation E1, should be designed and constructed to achieve the performance as described in Section 1.

2.1.3.9 When sound test measurements are made in small rooms, the results can be less accurate. Guidance on this is given in Appendix A, paragraph A.2.6.

2.1.4 Establishing the appropriate amount of testing required

2.1.4.1 The results of sound insulation tests only apply to the particular dwellings tested and are only indicative of the performance of others of the same construction type in the same development. Therefore in order for meaningful inferences to be made from tests, it is essential that developments are

³ A bonded resilient material is not a soft covering.

considered as a number of notional groups, with the same construction type in each group.

2.1.4.2 The two basic dwelling group types are dwelling houses (including bungalows) and apartments/ duplex dwellings.

2.1.4.3 If differences in construction type occur within these dwelling groups, sub-groups should be established accordingly.

2.1.4.4 For dwelling houses (including bungalows) sub-grouping should be established by the type of separating wall construction.

2.1.4.5 For apartments / duplex dwellings sub-grouping should be established by the type of separating wall and / or separating floor construction.

2.1.4.6 Sub-grouping is generally not necessary for dwelling houses or apartments/ duplex dwellings that have the same separating wall and / or separating floor construction type, with the same associated flanking construction(s), and where room dimensions and layouts are broadly similar.

2.1.5 Sets of tests

2.1.5.1 A number of individual sound tests is required to be carried out on a separating wall and / or separating floor construction to ensure accuracy. The aggregate number of individual tests conducted in a dwelling, apartment / duplex dwelling is referred to as a 'set of tests'. The number of individual sound insulation tests within a 'set of tests' is given in Table 2 below.

Table 2 Number of individual tests in a 'set of tests' (Par. 2.1.5.1)		
Type of test	Dwelling Group Types	
	Dwelling houses (including bungalows)	Apartments and duplex dwellings⁵
Airborne test of separating walls ¹	Yes	Yes
Airborne test of separating walls ²	Yes	Yes
Airborne test of separating floors ³	N/A	Yes
Airborne test of separating floors ⁴	N/A	Yes
Impact test of separating floors ³	N/A	Yes
Impact test of separating floors ⁴	N/A	Yes
Total No. of individual tests in a 'set of tests'⁵	2 No.	6 No.

NOTES:

1. A test of insulation against airborne sound between one pair of rooms. Living rooms on opposite sides of the separating wall should be chosen, where possible.
2. A test of insulation against airborne sound between another pair of rooms than in Note 1. Bedrooms on opposite sides of the separating wall should be chosen, where possible.
3. A test of insulation against airborne and impact sound between one pair of rooms. Living rooms above or below each other should be chosen, where possible.
4. A test of insulation against airborne and impact sound between another pair of rooms than in Note 3. Bedrooms above or below each other should be chosen, where possible.
5. To conduct a full 'set of tests' on any individual unit, access to other adjoining units will be required.

2.2 Programme of testing

2.2.1 General

2.2.1.1 The 'set of tests' as required by Table 2 should be carried out as part of the construction process and in accordance with the procedure set out in Appendix A.

2.2.2 Initial testing

2.2.2.1 On each site, at least one 'set of tests' should be carried out on a dwelling group or sub-group within the first four dwellings (of that group or sub group) which are planned for completion.

2.2.2.2 This applies regardless of the intended size of the group or sub-group. Therefore, if a site comprises of only one pair of dwelling houses or apartments / duplex dwellings, they should be tested.

2.2.3 Minimum frequency of testing

2.2.3.1 Assuming no initial tests have failed, the minimum number of 'sets of tests' for each group or sub-group is outlined in Table 3A. For failed tests, see paragraph 2.2.5.

2.2.3.2 The minimum number of 'sets of tests' required as outlined in Table 3A is applicable if the construction types in Section 3 and 4 are adhered to. For other construction types, see paragraphs 2.3 and 2.4.

2.2.3.3 Testing should be conducted more frequently at the beginning of a series of completions than towards the end, to allow any potential problems to be addressed at an early stage. On large developments testing should be carried out over a substantial part of the construction period.

2.2.4 Reporting procedure

2.2.4.1 A test report should be recorded in the recommended manner set out in Appendix A and retained as proof that the sound insulation performance has been met.

Table 3A Minimum frequency of testing per group or sub-group type (Par. 2.2.3)	
Number of attached dwellings	'Sets of tests' required
4 or less	At least 1 ¹
Greater than 4 but less than or equal to 20	At least 2
Greater than 20 but less than or equal to 40	At least 2 + 10% x No. of attached dwellings greater than 20
Greater than 40 but less than or equal to 100	At least 4 + 5% x No. of attached dwellings greater than 40
More than 100	At least 7 + 5% x No. of attached dwellings greater than 100

NOTES:

1. This also satisfies the initial testing requirements (see paragraph 2.2.2).
2. Refer to Table 2 for number of individual tests required in a 'set of tests'.
3. Round up to the nearest whole number.
4. Refer to paragraph 2.3 where constructions other than those detailed in Section 3 and 4 are used.

2.2.5 Actions following a failed set of tests

2.2.5.1 A 'set of tests' is deemed to have failed if any of the individual tests of airborne or impact sound insulation do not show sound insulation values equal to or better than those set out in Table 1.

2.2.5.2 Where a failed test has occurred, remedial works to the failed element should be carried out until the element at least meets the performance levels of Table 1 when re-tested. Dwellings on the same site completed prior to the failed test (excluding those proven acceptable by previous tests) should either have similar remedial work carried out or demonstrate by testing that they meet the performance levels of Table 1.

2.2.5.3 Where remedial work and a new test is required on any dwelling, the number of 'sets of tests' required as per Table 3A (or Table 3B as applicable) should be increased by one, for that group or sub-group type.

2.2.5.4 Where the cause of the failure is attributed to the construction of the separating element and / or associated flanking provisions, other separating elements of similar construction (where compliance is demonstrated by inference) or that have not been tested may also fail to meet the performance levels of Table 1. Therefore, remedial treatment on all these elements should also be carried out.

2.3 Assessed Sound Details (ASDs)

2.3.1 General

2.3.1.1 Where construction types other than those in Sections 3 or 4 are employed, the testing frequency outlined in Table 3A may still be used provided the construction type has been assessed and certified in accordance with Appendix B.

NOTE: *Appendix B provides guidance appropriate to Part E only. All elements incorporated into the building must comply with all relevant parts of the Building Regulations.*

2.4 Other constructions

2.4.1. General

2.4.1.1 Where construction types other than those in Sections 3 or 4, or ASDs in accordance with paragraph 2.3 are employed, it is essential that these construction types can demonstrate their capability of meeting the required performance level on each individual site. Therefore, the frequency of initial testing in paragraph 2.2.2 should be increased to that set out in 2.4.1.2.

2.4.1.2 On each site a 'set of tests' should be carried out on every dwelling within a group or sub-group within the first eight dwellings (of that group or sub group) which are planned for completion.

2.4.1.3 Assuming none of these tests have failed the minimum number of 'sets of tests' for each group type or sub-group is outlined in Table 3B. For failed tests, see paragraph 2.2.5.

Table 3B Other constructions - minimum frequency of testing per group or sub-group type (Par. 2.4.1.3)	
Number of attached dwellings	'Sets of tests' required
First 8 dwellings (or part thereof) planned for completion	At least one 'set of test' for each separating element up to 4 No. 'sets of tests' ¹
Greater than 8 but less than or equal to 20	At least 6 (in total)
Greater than 20 but less than or equal to 40	At least 6 + 10% x No. of attached dwellings greater than 20
Greater than 40 but less than or equal to 100	At least 8 + 5% x No. of attached dwellings greater than 40
More than 100	At least 11 + 5% x No. of attached dwellings greater than 100
<p>NOTES:</p> <ol style="list-style-type: none"> 1. This satisfies testing requirements of paragraph 2.4.1.2. 2. Refer to Table 2 for number of individual tests required in a 'set of tests'. 3. Round up to the nearest whole number. 	

Section 3

Separating walls and associated flanking construction details

3.1 Separating wall construction

3.1.1 General

3.1.1.1 This section gives examples of wall types which, if constructed correctly, should achieve the performance level set out in Table 1.

3.1.1.2 Guidance is provided to enable compliance with Part E only. It should be noted that all elements incorporated into the building must comply with all relevant parts of the Building Regulations.

3.1.2 Types of wall

3.1.2.1 Separating walls are grouped into four main types as follows (refer to Diagram 3):


3.1.2.2 Wall Type 1 (WT 1) - Solid masonry / concrete with plaster finish. The resistance to airborne sound depends mainly on the mass per unit area of the wall (see Diagram 3(a)).

3.1.2.3 Wall Type 2 (WT 2) - Solid masonry with dry lining. The resistance to airborne sound depends mainly on the mass of the core (dense block), the absorption of the mineral wool and the isolation (de-coupling) of the dry lining (see Diagram 3(b)).


3.1.2.4 Wall Type 3 (WT 3) - Cavity masonry with plaster finish. The resistance to airborne sound depends mainly on the mass per unit area of the leaves of the wall and on the degree of isolation provided by the cavity. The isolation is affected by connections (such as wall ties and foundations) between the wall leaves and by the cavity width (see Diagram 3(c)).

3.1.2.5 Wall Type 4 (WT 4) – Timber framed walls with absorbent material. The resistance to airborne sound depends on the mass per unit area of the leaves, the isolation of the timber frames, and the absorption in the cavity between the frames (see Diagram 3(d)).


Diagram 3 Types of wall
(Par. 3.1.2.)

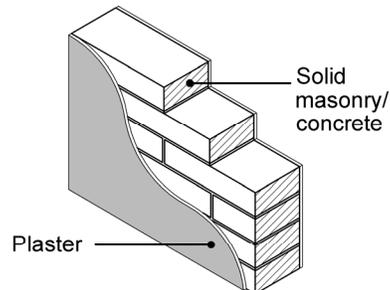


(a) **WT 1** - Solid masonry/ concrete with plaster finish

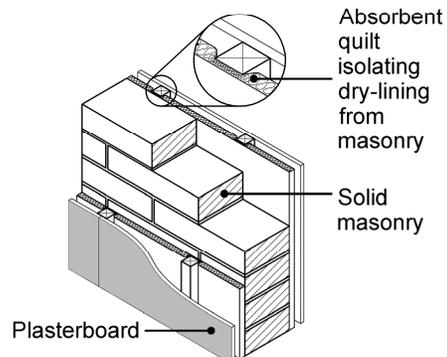

(b) **WT 2** - Solid masonry with dry lining

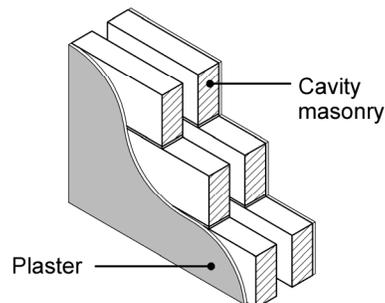

(c) **WT 3** - Cavity masonry with plaster finish

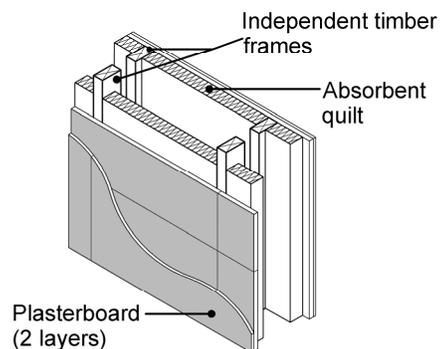

(d) **WT 4** - Timber framed walls with absorbent material

3.2 Flanking provisions

3.2.1 General

3.2.1.1 In order for the separating wall construction to be fully effective, care should be taken to correctly detail the junctions between the separating wall and other elements, such as floors, roofs, external walls and internal walls.

3.2.2 Junctions between separating walls and other building elements

3.2.2.1 Guidance is given below to control flanking transmission at the junction of the separating wall types and other building elements.

3.2.2.2 Table 4 outlines the illustrations provided in this document on the junctions that may occur between each of the four separating wall types discussed in 3.1.2 and the various attached building elements.

3.2.3 Corridor walls

3.2.3.1 The separating walls described in this section should be used between common corridors and dwellings, in order to control flanking transmission and to provide the required sound insulation.

3.2.4 Entrance doors opening onto a common area of a building

3.2.4.1 An entrance door in a separating wall dividing a dwelling from a common area of a building can create a weak point acoustically in the wall, allowing unwelcome noise into the dwelling. However, it is not considered reasonable to maintain the same acoustic performance for doors as for separating walls. To maximise the sound resistance of the door set, it should be ensured that the door frame is fitted tight against the wall opening and the door has good perimeter sealing and a mass per unit area of 25 kg/m² (min) or a sound reduction index of 29 dB R_w (min) measured in accordance with I.S. EN ISO 717. The door should satisfy the requirements of Part B – Fire Safety.

3.2.5 Noise from services

3.2.5.1 Building service installations have the potential to cause noise nuisance, e.g. passenger lifts, refuse chutes, air conditioning units, and ventilation systems. Drainage pipes running the height of a block of apartments have also been a source of complaints. The design of building services, their position in the building and the building structure should be considered at an early stage in the design process, to reduce their impact on occupants of apartment buildings.

3.2.5.2 Internal noise levels are affected by room layout. The layout should be considered at the design stage to avoid placing noise sensitive rooms next to rooms in which noise is generated where possible. Additional guidance is provided in BS 8233 Sound Insulation and noise reduction for buildings - Code of practice and sound control for homes.

3.2.5.3 Lightweight structures need special consideration and it may be appropriate to support noisy plant on a separate, rigid structure. Structure borne noise is a common cause of complaints and the most effective approach is to structurally de-couple service installations and mechanical equipment from separating walls and separating floors.

Table 4 Reference table of illustrations provided on separating wall junctions (Par 3.2.2.2)					
	Separating Wall Type				
	WT 1 <i>Solid masonry/ concrete with plaster finish (Diagram 4)</i>	WT 2 <i>Solid masonry with dry-lining (Diagram 8)</i>	WT 3 <i>Cavity masonry with plaster finish (Diagram 12)</i>	WT 4A <i>Twin leaf timber frame without sheathing (Diagram 17A)</i>	WT 4B <i>Twin leaf timber frame with sheathing (Diagram 17B)</i>
Separating Floor Type²					
FT 1 <i>Resilient material bonded to concrete base with ceiling under (Diagram 32)</i>	Diagram 34A	Diagram 34B	Diagram 35	Not applicable	Not applicable
FT 2 <i>Floating layer on concrete base with ceiling under (Diagram 37)</i>	Diagram 39A	Diagram 39B	Diagram 40	Not applicable	Not applicable
FT 3 <i>Floating layer on timber base with ceiling under (Diagram 42)</i>	Not applicable	Not applicable	Not applicable	Diagram 44	Diagram 44
Flanking requirements					
External wall	Diagram 5 Diagram 6	Diagram 9 Diagram 10	Diagram 13 Diagram 14 Diagram 15	Diagram 18	Diagram 23
Ceiling and roof space	Diagram 7A	Diagram 11A	Diagram 16A	Diagram 19A	Diagram 24A
Internal floor - timber	Diagram 7B	Diagram 11B	Diagram 16B	Diagram 19B	Diagram 24B
Internal floor – concrete	Diagram 7C	Diagram 11C	Diagram 16C	Not applicable	Not applicable
Ground floor – concrete	Diagram 7D	Diagram 11D	Diagram 16D	Diagram 20A Diagram 21	Diagram 25A Diagram 26
Ground floor - timber	Diagram 7D	Diagram 11D	Diagram 16D	Diagram 20B	Diagram 25B
Guidance on services	Diagram 5 Diagram 6	Diagram 9 Diagram 10	Diagram 14 Diagram 15	Diagram 22	Diagram 27
NOTES:					
1. The illustrations and guidance are provided to enable compliance with Part E only. It should be noted that all elements incorporated into the building works must comply with all relevant parts of the Building Regulations.					
2. Where separating floors are used e.g. apartments, reference should be made to Section 4, Table 5 for associated flanking construction details.					

3.3 Wall Type 1 (WT 1) - Solid masonry /concrete with plaster finish

3.3.1 General

3.3.1.1 The resistance to airborne sound depends mainly on the mass per unit area of the wall.


3.3.2 Wall specification

3.3.2.1 Two Wall Type 1 constructions are described in Diagram 4.

3.3.3 Key junctions and flanking details

3.3.3.1 Details of key junctions (including flanking transmission) in the construction of WT 1A are described in Diagrams 5 to 7. Similar details are also applicable to WT 1B.

Diagram 4 WT 1 Solid masonry / concrete with plaster finish –Specification
(Par 3.3.2)

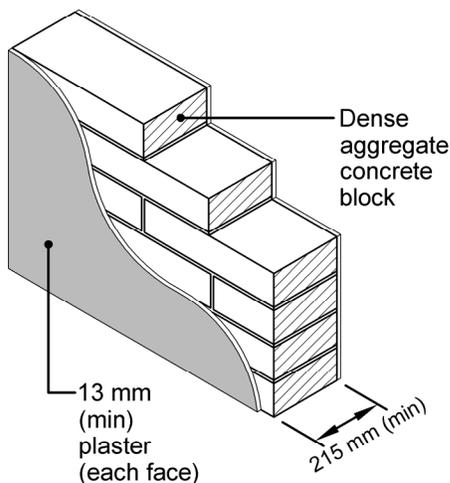

WT 1A - Solid masonry plastered on both faces

Specification


Dense aggregate concrete blockwork plastered on both faces. The minimum mass of the wall (including the plaster) should be 415 kg/m^2 . The thickness of the plaster should be at least 13 mm per face. Use blocks that are laid full wall width i.e. 215 mm wide blocks laid on flat using single course stretcher bond only (not double coursing).

Example

215mm dense aggregate concrete block (density of 1900 kg/m^3 min) laid flat, 112.5 mm coursing (single course stretcher bond only), plastered with 13 mm plaster (mass per unit area 10 kg/m^2 min) on both faces.

Key Points to Watch

- **DO NOT** use double coursing.
- Fill all joints between blocks with mortar, and seal the joints between the wall and the other parts of the construction (to achieve the mass and avoid air paths).

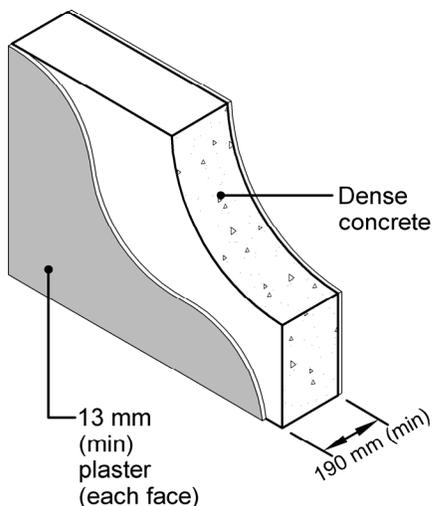

WT 1B - Dense concrete plastered on both faces

Specification

The minimum mass of the wall (including the plaster) should be 415 kg/m^2 . The thickness of the plaster should be at least 13 mm per face.



Example

Dense concrete (cast insitu or precast), 190 mm (min) thickness with a density of 2200 kg/m^3 (min), plastered with 13 mm (min) plaster with a mass per unit area 10 kg/m^2 (min) on both faces.

Key Points to Watch

- Fill all joints between precast panels with mortar to full depth of panel, and seal the joints between the wall and the other parts of the construction (to achieve the mass and avoid air paths).

Diagram 5 WT 1A Solid masonry with plaster finish - Flanking requirements at an external (flanking) wall (similar details are applicable for WT 1B) (Par 3.3.3)

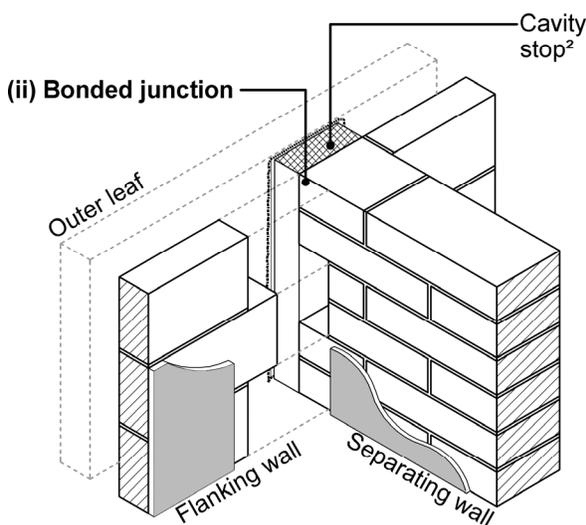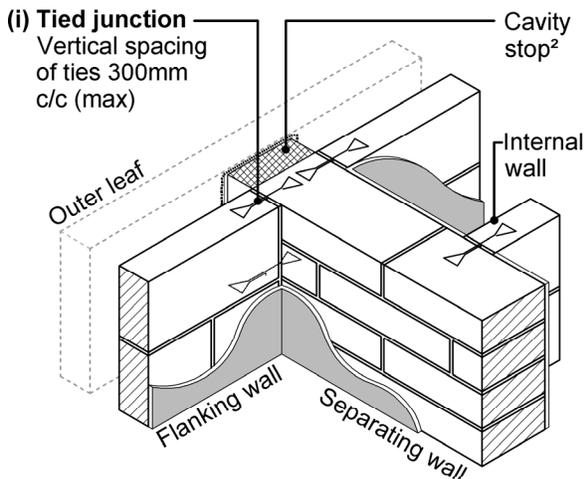

Flanking wall requirements

The flanking wall should be of masonry construction and should have a mass of at least 120 kg/m² excluding any finish.

The flanking wall should be joined to the separating wall using one of the following methods:

- (i) butted to it and secured with wall ties spaced at 300 mm (max) vertical c/c, or
- (ii) bonded to the separating wall ensuring that the separating wall contributes at least 50% of the bond at the junction.

Note: using method (i) of butted and tied, typically improves sound insulation performance by 2 - 3 dB, versus method (ii) bonded junction.

Where the external wall is a cavity wall:

- a) the outer leaf may be of any construction.
- b) the cavity should be stopped with a flexible closer to minimise sound transmission along the cavity unless the cavity is fully filled with mineral wool or expanded polystyrene beads (seek manufacturers advice for other suitable materials).
- c) the cavity stop should be protected from moisture transfer across the cavity.


Key Points to Watch

- **DO NOT** use double coursing. Use single course stretcher bond only.
- Fill all the joints between the blocks with mortar.
- Seal the joints between the wall and other parts of the construction (to achieve the mass and avoid airpaths), including those behind plasterboard dry-linings.
- **DO NOT** place sockets back to back on opposite sides of separating walls and avoid deep chases.

NOTES:

1. Thermal insulation omitted for clarity
2. Cavity stops are specified for the purposes of minimising flanking sound transmission along the cavity. A cavity stop may also be required to act as a cavity barrier for the purposes of compliance with Part B - Fire Safety, see TGD B.

Diagram 6 WT 1 Solid masonry/ concrete with plaster finish - Position of openings in an external (flanking) wall
(Par. 3.3.3)

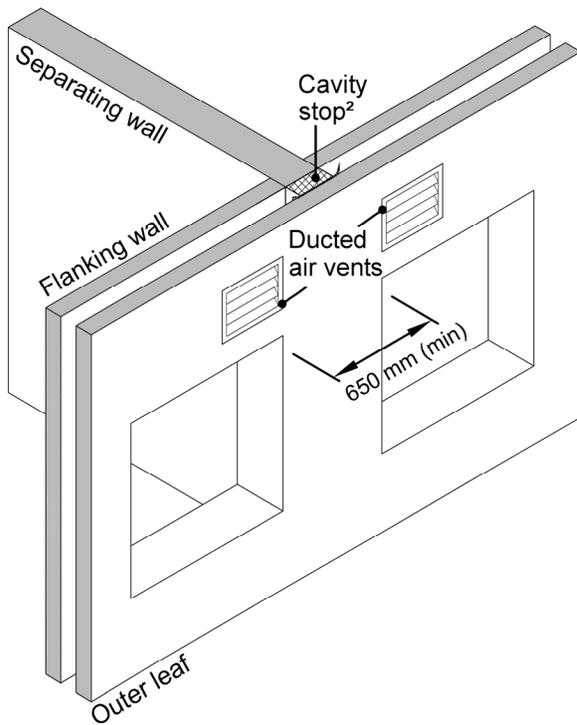


Key Points to Watch

- There should be 650 mm (min) clear between all openings (doors, windows or ducted vents) in the external wall on either side of the separating wall.

NOTES:

1. Thermal insulation omitted for clarity.
2. Cavity stops are specified for the purposes of minimising flanking sound transmission along the cavity. A cavity stop may also be required to act as a cavity barrier for the purposes of compliance with Part B - Fire Safety, see TGD B.

Diagram 7 WT 1 Solid masonry with plaster finish – Key junction details
(Par. 3.3.3)

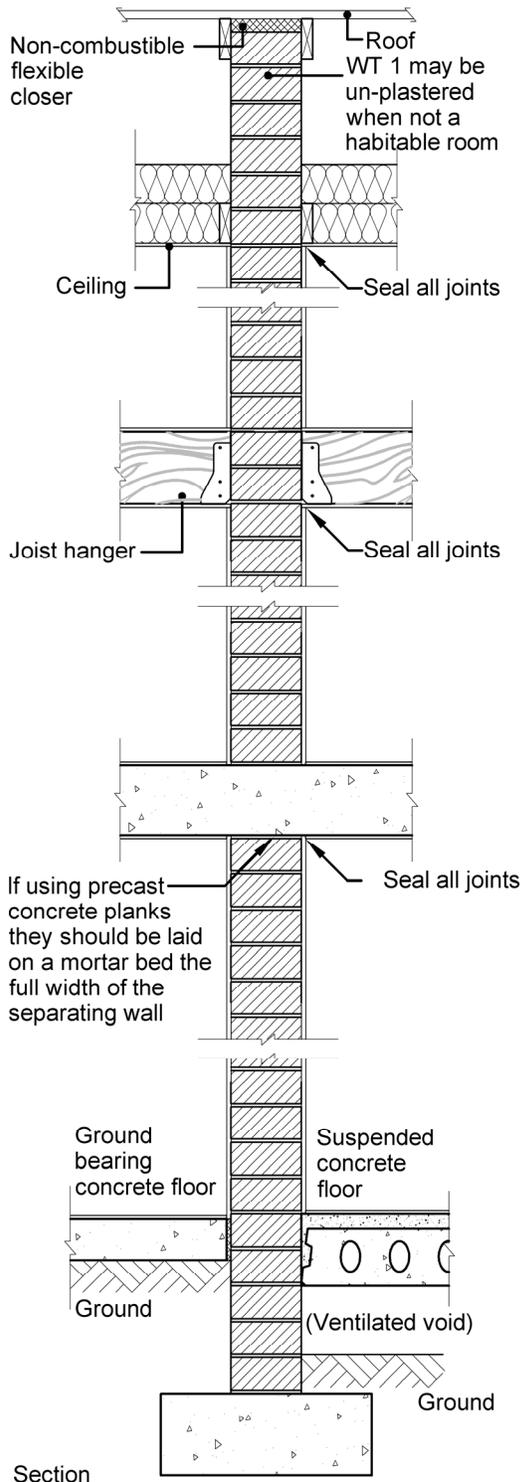

A) Junctions with ceiling and roof

Key Points to Watch

- WT 1 should be continuous to the underside of the roof (but may be un-plastered) and the junction between the separating wall and the roof should be filled with a flexible closer which is also suitable as a fire stop.
- Close the cavity of external cavity walls at eaves level with a suitable flexible material (e.g. mineral wool).

B) Junction with an internal timber floor

Key Points to Watch

- If timber joists are supported on a separating wall joist hangers must be used.
- **DO NOT** use saddle type joist hangers.
- **DO NOT** build timber floor joists into a separating wall.
- Where steel beams are built into a separating wall, all voids around the beam should be filled with mortar or flexible sealant

C) Junction with internal concrete floor

Key Points to Watch

- A concrete floor may be carried continuous through a separating wall if the floor slab has a mass per unit area of at least 365 kg/m².
- Hollowcore concrete plank floors should not be continuous through a WT 1.
- If hollow core planks are used of a type where the cores are continuous through the planks and the planks are laid so that the cores join up, the cores should be sealed with mortar at the separating wall junction.
- All gaps between the underside of the floor plate and the top of the wall must be filled.

D) Junction with ground floors

Key Points to Watch

(i) Concrete ground floors

- Ground floor may be a solid concrete slab, suspended concrete floor or laid on the ground.
- Suspended concrete floor may only pass under a WT 1 if the floor mass is greater than 365 kg/m².
- Hollowcore concrete plank floors should not be continuous across a WT 1.

(ii) Timber ground floors

- The notes in B) above apply.

3.4 Wall Type 2 (WT 2) - Solid masonry with dry lining

3.4.1 General

3.4.1.1 The resistance to airborne sound depends mainly on the mass of the core mass (dense block), the absorption of the mineral wool and the isolation (de-coupling) of the dry lining.

3.4.2 Wall specification

3.4.2.1 Wall Type 2 construction (with different lining options) is described in Diagram 8.

3.4.3 Key junctions and flanking details

3.4.3.1 Details of key junctions in the construction of WT 2 and details to limit flanking transmission are described in Diagrams 9 to 11.

Diagram 8 WT 2 Solid masonry with dry lining – Specification
(Par 3.4.2)




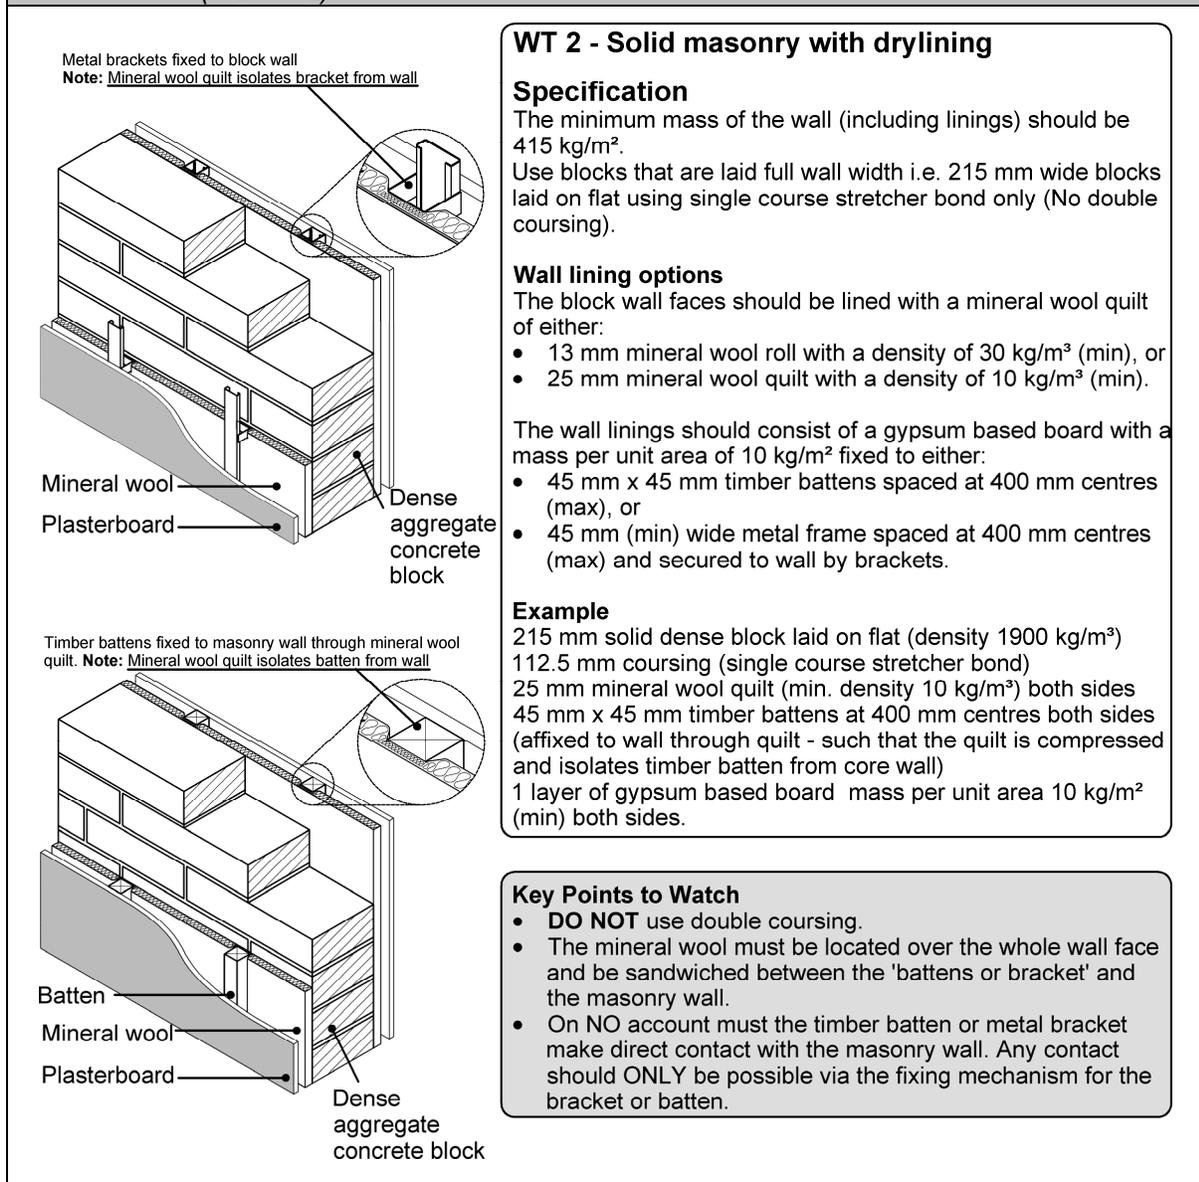


Diagram 9 WT 2 Solid masonry with dry lining – Flanking requirements at an external (flanking) wall
(Par 3.4.3)

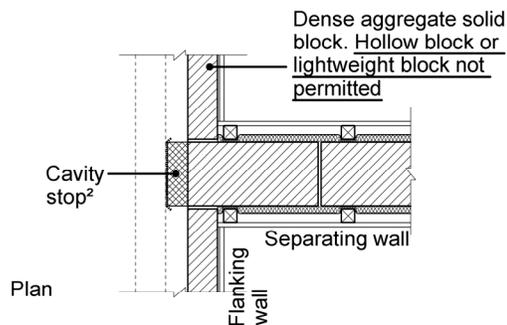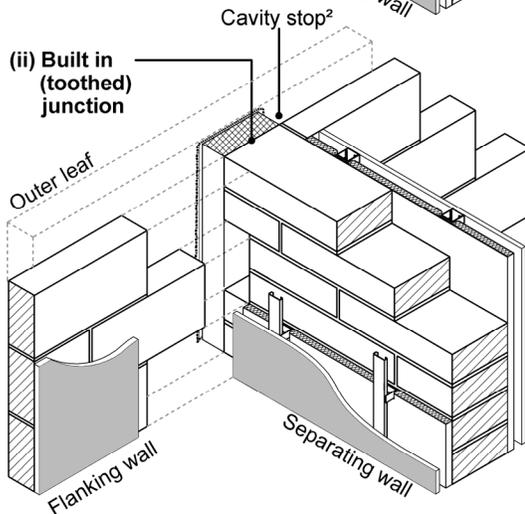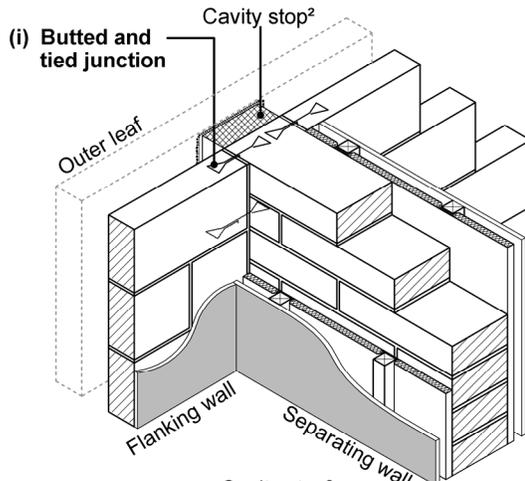

Flanking wall requirements

The flanking wall must be 100 mm (min) thick dense aggregate block with a density of 1900 kg/m³ (min).

NOTE: This detail does not support the use of hollow block or light weight block flanking walls.

The continuity of the flanking wall must be broken by the separating wall and should be joined to the separating wall using one of the two following methods:

- (i) butted and tied and secured with integral wall ties at no more than 300mm vertical centres, or
- (ii) built-in (toothed) every second course of the inner leaf.

NOTE: Using method (i) of butted and tied, typically improves sound insulation performance by 2 - 3 dB, versus method (ii) of built-in (toothed).

Linings to the flanking may be gypsum based board, insulated plasterboard or plaster.

Where the external flanking wall is a cavity wall:

- a) the outer leaf may be of any construction.
- b) the cavity should be stopped with a flexible closer to minimise sound transmission along the cavity unless the cavity is fully filled with mineral wool or expanded polystyrene beads (seek manufacturers advice for other suitable materials).
- c) the cavity stop should be protected from moisture transfer across the cavity.


Key Points to Watch

- **DO NOT** use double course, use single coursing only.
- Fill all the joints between the blocks with mortar.
- **ENSURE** there is a good seal between the flanking wall and the separating wall with full depth mortar joints.
- **ENSURE** the separating wall linings are taken up to the blockwork face of the flanking wall.
- **DO NOT** chase the masonry wall for sockets as the drylining void may be used for this purpose.
- Lining to the flanking wall (inner leaf) may be gypsum based board or insulation backed gypsum based board on dabs.

NOTES:

- 1. Thermal insulation omitted for clarity
- 2. Cavity stops are specified for the purposes of minimising flanking sound transmission along the cavity. A cavity stop may also be required to act as a cavity barrier for the purposes of compliance with Part B - Fire Safety, see TGD B.

Diagram 10 WT 2 Solid masonry with dry lining - Position of openings in an external (flanking) wall
(Par. 3.4.3)

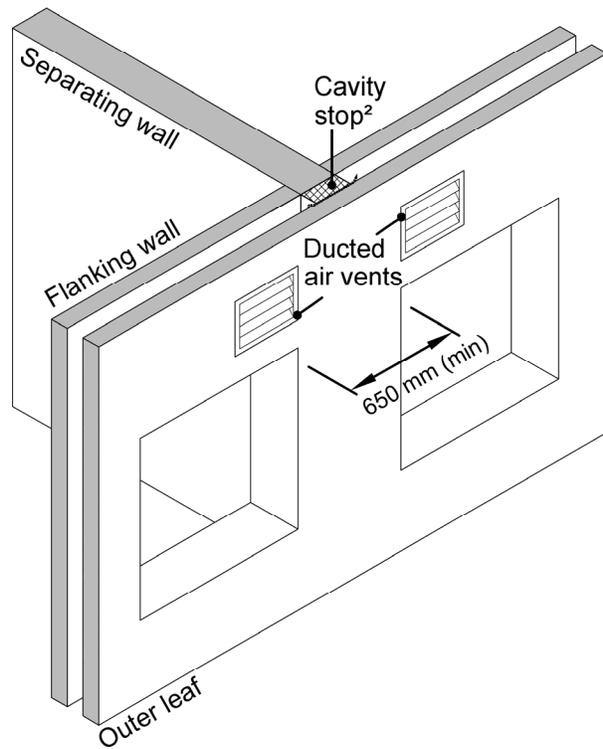


Key Points to Watch

- There should be 650 mm (min) clear between all openings (doors, windows or ducted vents) in the external wall on either side of the separating wall.

NOTES:

1. Thermal insulation omitted for clarity.
2. Cavity stops are specified for the purposes of minimising flanking sound transmission along the cavity. A cavity stop may also be required to act as a cavity barrier for the purposes of compliance with Part B - Fire Safety, see TGD B.

Diagram 11 WT 2 Solid masonry with dry lining – Key junction details
(Par 3.4.3)

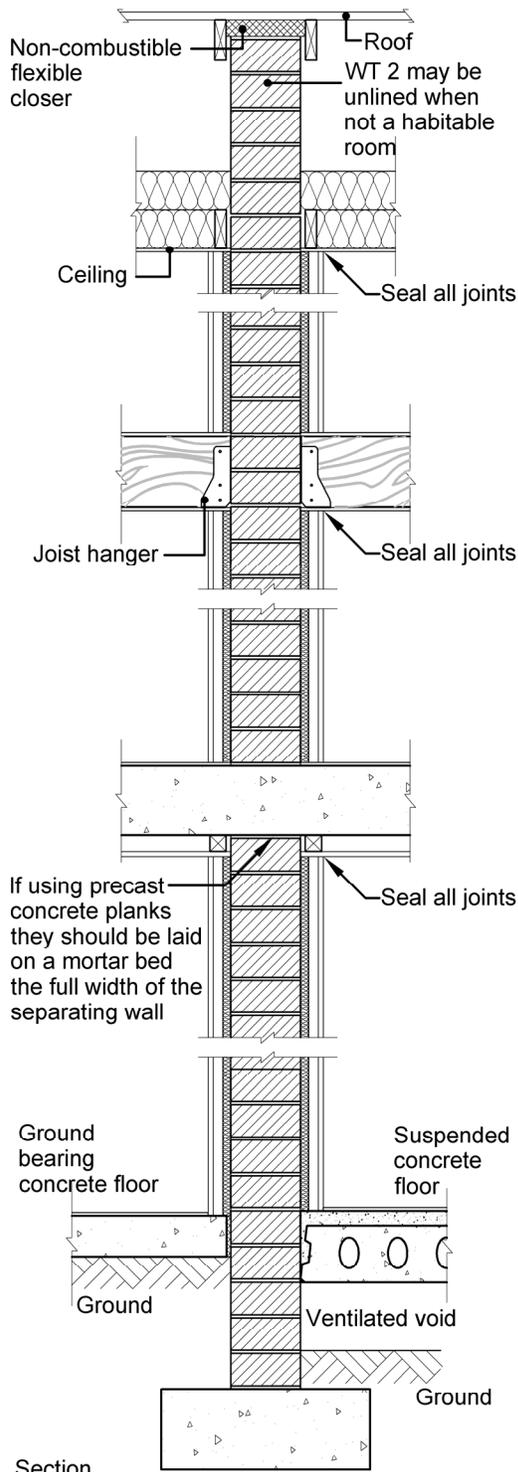

A) Junctions with ceiling and roof

Key Points to Watch

- WT 2 should be continuous to the underside of the roof and the junction between the separating wall and the roof should be filled with a flexible closer which is also suitable as a fire stop.
- Close the cavity of external cavity walls at eaves level with a suitable flexible material (e.g. mineral wool).
- Ceiling lining to be one layer of gypsum based board 10 kg/m² (min).

B) Junction with internal timber floor

Key Points to Watch

- Where possible internal floor joists should run parallel to the separating wall. If timber or lightweight steel joists are to be supported on a separating wall joist hangers **MUST** be used. **DO NOT** build in floor joists to the separating core wall.
- **DO NOT** use saddle type joist hangers.
- The separating wall linings should cover the whole of the room face of the separating wall. They are NOT required between the joists.
- **ENSURE** the flooring boards close off the cavity at the base of the separating wall linings.
- **ENSURE** the ceiling board closes off the cavity at the top of the separating wall linings.

C) Junction with internal concrete floor

Key Points to Watch

- Concrete slabs may be carried continuous through a separating wall provided:
 - a) the concrete slab is solid and has a mass per unit area of 365 kg/m² (min), and
 - b) a gypsum based ceiling system is mounted to the underside of the slab, either on timber straps or metal frame, which shields the slab.
- Precast hollowcore concrete slabs may be built into the separating wall but slabs **MUST NOT** be continuous between adjoining dwellings. The junctions between the slabs must be fully grouted and sealed.
- For all concrete floors the junctions between the head of the separating wall and the slab **must be** fully sealed with mortar and no gaps should remain.
- Ceiling may be plastered or battened and slabbed to accommodate services.

D) Junction with ground floors

Key Points to Watch

(i) Concrete ground floors

- The ground floor may be a solid concrete slab, laid on the ground or suspended concrete floor.
- A concrete floor may only be continuous under WT 2 if:
 - a) the concrete floor has a mass per unit area of 365 kg/m² (min), and
 - b) the concrete floor is solid.
- Precast hollowcore concrete slabs/ planks or concrete beams with infilling blocks **SHOULD NOT** be continuous under a WT 2 separating wall.

(ii) Timber ground floors

- The notes for B) above apply.

3.5 Wall Type 3 (WT 3) Cavity masonry wall with plaster finish

3.5.1 General

3.5.1.1 The resistance to airborne sound depends mainly on the mass per unit area of the leaves of the wall and on the degree of isolation provided by the cavity. The isolation is affected by connections (such as wall ties and foundations) between the wall leaves and by the cavity width.


3.5.2 Wall specification

3.5.2.1 Wall Type 3 construction is described in Diagram 12.

3.5.3 Key junctions and flanking details

3.5.3.1 Details of key junctions in the construction of WT 3 and details to limit flanking transmission are described in Diagrams 13 to 16.

Diagram 12 WT 3 Cavity masonry with plaster finish – Specification
(Par 3.5.2)

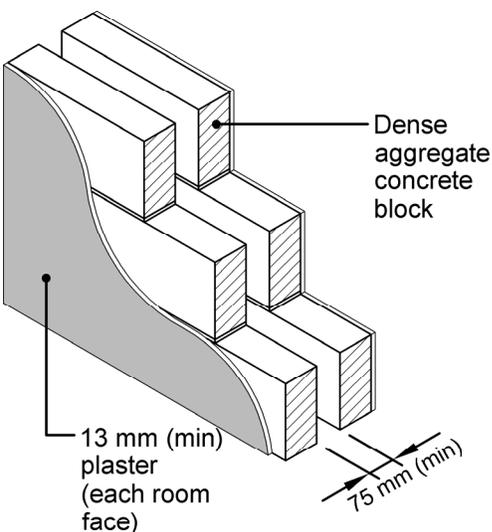

WT 3 - Cavity masonry with plaster finish

Specification

Dense aggregate concrete blockwork plastered on both room faces.

The minimum mass of the wall (including the plaster) should be 415 kg/m².

The thickness of the plaster should be 13 mm (min) per room face.

The width of the cavity should be 75 mm (min).

Connect the block leaves with wall ties with a dynamic stiffness < 4.8MN/m³ for the specified minimum cavity, at a standard density.

Example

Two leaves of 100 mm dense aggregate concrete block of block density 1900 kg/m³ (min). Provide 75 mm (min) cavity between leaves. 225 mm coursing (single course stretcher bond only), plaster on both faces with 13 mm (min) lightweight plaster of mass per unit area 10 kg/m² (min).


Key Points to Watch

- Fill all joints between blocks with mortar, and seal the joints between the wall and the other parts of the construction (to achieve the mass and avoid air paths).


Diagram 13 WT 3 - Cavity masonry wall with plaster finish - Flanking requirements for an external (flanking) wall
(Par. 3.5.3)

(i) Tied junction

Vertical spacing of ties not greater than 300 mm c/c

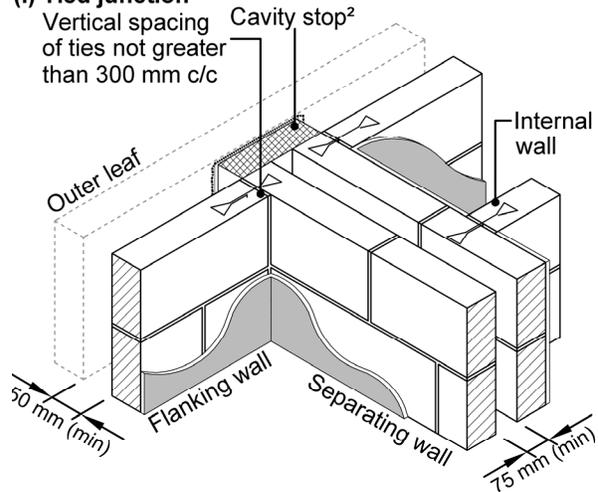

(ii) Bonded junction

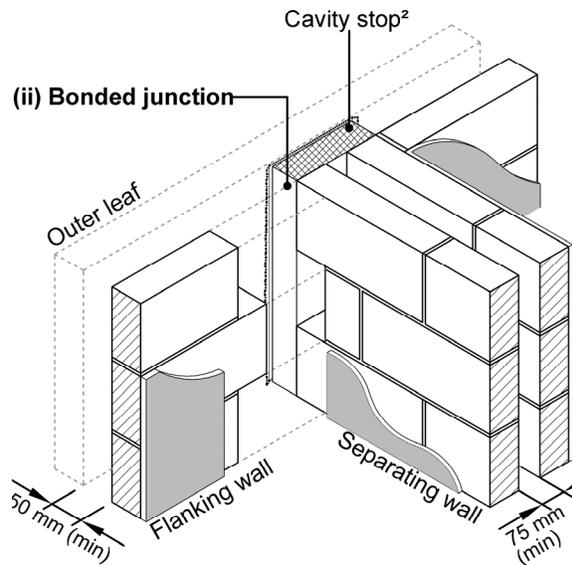

Flanking wall requirements

The flanking wall should be of masonry construction and should have a mass of at least 120 kg/m² excluding any finish.

The flanking wall (either a solid wall or the inner leaf of a cavity wall) should be joined to the separating wall using one of the following methods:

- (i) butted to it and secured with wall ties (or similar) spaced at no more than 300 mm vertical c/c; or
- (ii) bonded to the sound resisting wall ensuring that the separating wall contributes at least 50 % of the bond at the junction.

Where the external wall is a cavity wall:

- a) the outer leaf may be of any construction.
- b) the cavity should be stopped with a flexible closer to minimise sound transmission along the cavity.
- c) the cavity stop should be protected from moisture transfer across the cavity.
- d) If the cavity is fully filled with mineral wool or expanded polystyrene beads (seek manufacturers advice for other suitable materials).

NOTE: If a cavity in an external wall is completely filled with an insulating material other than loose fibre, care should be taken that the insulating material does not enter the cavity in the separating wall.

- e) the external cavity width should be 50 mm (min).


Key Points to Watch

- Fill all the joints between the blocks with mortar.
- Seal the joints between the wall and other parts of the construction (to achieve the mass and avoid airpaths), including those behind plasterboard dry-linings.
- **DO NOT** use deep sockets and chases in separating walls.
- **DO NOT** place sockets back to back on opposite sides of separating walls.

NOTES:

1. Thermal insulation omitted for clarity
2. Cavity stops are specified for the purposes of minimising flanking sound transmission along the cavity. A cavity stop may also be required to act as a cavity barrier for the purposes of compliance with Part B - Fire Safety, see TGD B.

Diagram 14 WT 3 Cavity masonry with plaster finish – Flanking requirements in staggered external wall
(Par. 3.5.3)

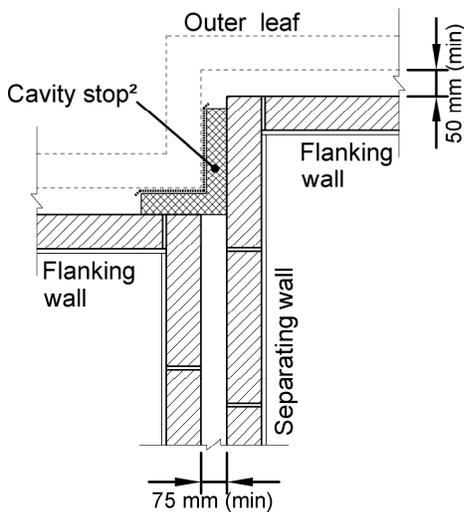


Key Points to Watch

- The cavity should be stopped with a flexible closer to minimise sound transmission along the cavity, unless the cavity is fully filled with mineral wool or expanded polystyrene beads (seek manufacturers advice for other suitable materials).
- The external cavity width should be 50 mm (min).

NOTES:

1. Thermal insulation omitted for clarity.
2. Cavity stops are specified for the purposes of minimising flanking sound transmission along the cavity. A cavity stop may also be required to act as a cavity barrier for the purposes of compliance with Part B - Fire Safety, see TGD B.

Diagram 15 WT 3 Cavity masonry with plaster finish - Position of openings in an external (flanking) wall
(Par. 3.5.3)

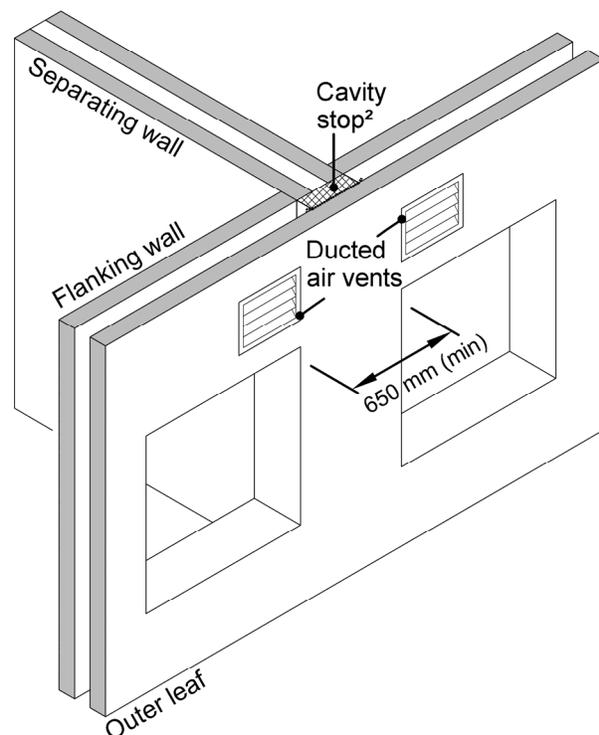


Key Points to Watch

- There should be 650 mm (min) clear between all openings (doors, windows or ducted vents) in the external wall on either side of the separating wall.

NOTES:

1. Thermal insulation omitted for clarity.
2. Cavity stops are specified for the purposes of minimising flanking sound transmission along the cavity. A cavity stop may also be required to act as a cavity barrier for the purposes of compliance with Part B - Fire Safety, see TGD B.

Diagram 16 WT 3 Cavity masonry with plaster finish – Key junction details
(Par. 3.5.3)

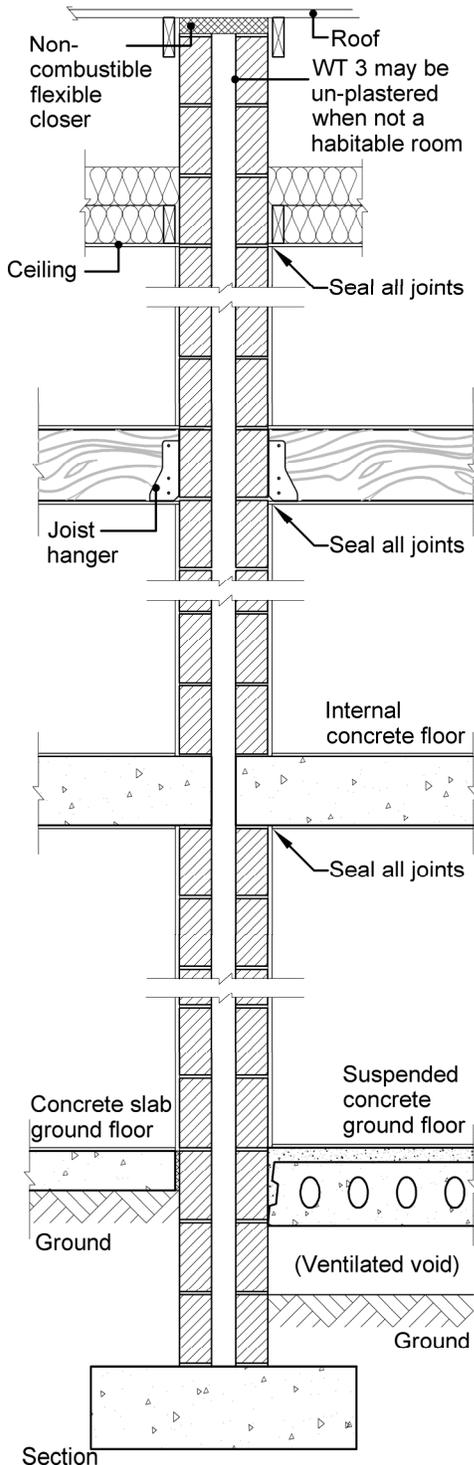

A) Junctions with ceiling and roof

Key Points to Watch

- Where a WT 3 is used it should be continuous to the underside of the roof.
- The junction between the separating wall and the roof should be filled with a flexible closer which is also suitable as a fire stop.
- Where there is an external cavity wall, the cavity should be closed at eaves level with a suitable flexible material (e.g. mineral wool).

B) Junction with internal timber floor

Key Points to Watch

- Where possible run joists parallel to separating walls.
- If timber joists are supported on a separating wall joist hangers must be used. Saddle hangers should not be used.
- **DO NOT** build in timber floor joists.

C Junctions with internal concrete floors

Key Points to Watch

- Internal concrete floors should generally be built into a WT 3 and carried through to the cavity face of the leaf.
- **DO NOT** bridge the cavity (except for wall ties).

D Junction with ground floors

Key Points to Watch

- (i) Concrete ground floors**
 - The ground floor may be a solid concrete slab, laid on the ground or a suspended concrete floor.
 - A concrete slab floor on the ground should not be continuous under a WT 3 separating wall.
 - A suspended concrete floor should not be continuous under a WT 3 separating wall, and should be carried through to the cavity face of the leaf. The cavity should not be bridged.
- (ii) Timber ground floors**
 - If the floor joists are to be supported on the separating wall then they should be supported on hangers and should not be built in. See Diagram 14B.

3.6 Wall Type 4 (WT 4) – Timber framed wall with absorbent material

3.6.1 General

3.6.1.1 The resistance to airborne sound depends on the mass per unit area of the leaves, the isolation of the frames, and the absorption in the cavity between the timber frames.

3.6.1.2 Timber frame dwellings should comply with the requirements of Irish Standard I.S. 440 Timber frame construction, dwellings and other buildings.


3.6.2 Wall specification

3.6.2.1 Two Wall Type 4 constructions are outlined in Diagram 17.

3.6.3 Key junctions and flanking details

3.6.3.1 Details of key junctions in the construction of WT 4A and WT 4B and details to limit flanking transmission are described in Diagrams 18 to 27.

Diagram 17 WT 4 Timber framed walls with absorbent material – Specification
(Par. 3.6.2)

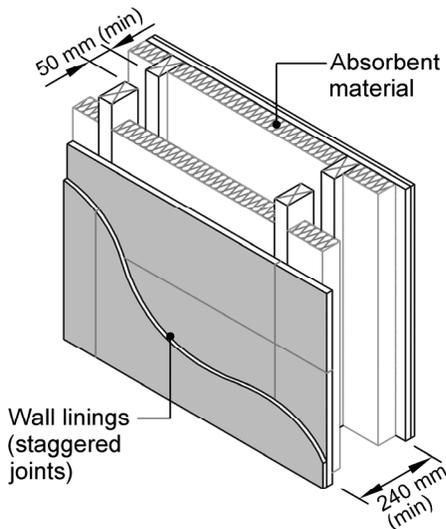

A) WT 4A - Twin leaf timber frame without sheathing


Specification

Wall width: 240 mm (min) between the inner faces of the wall linings. 50 mm (min) gap between studs. (Twin leaves must not be bridged by diagonal bracing).

Wall lining: two or more layers of gypsum based board with staggered joints (total nominal mass per unit area = 22 kg/m² (min) both sides).

Absorbent material: 60 mm (min) mineral wool batts or quilt (paper faced, unfaced or wire reinforced) both sides (density 10-60 kg/m³).

Ties: Ties between frames (no more than 40 mm x 3 mm) at 1200 mm (min) c/c horizontally, one tie per storey height vertically.

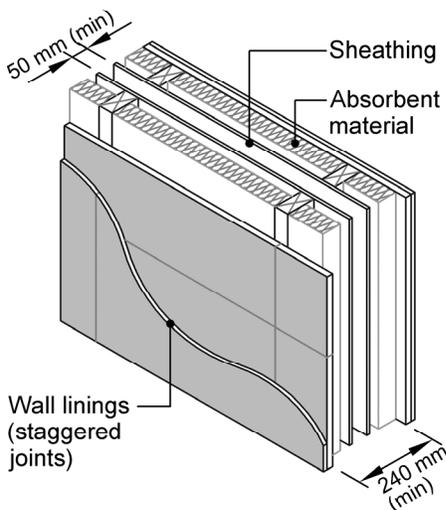

B) WT 4B - Twin leaf timber frame with sheathing

Specification

Wall width: 240 mm (min) between inner faces of the wall linings. 50 mm (min) gap between inner sheathing faces. (Twin leaves must not be bridged by diagonal bracing).

Wall lining: two or more layers of gypsum based board with staggered joints (total nominal mass per unit area 22 kg/m² (min) both sides).

Absorbent material: 60mm (min) mineral wool batts/ quilt (paper faced, unfaced or wire reinforced) both sides (density 10-60 kg/m³).


Ties: Ties between frames (no more than 40 mm x 3 mm) at 1200 mm (min) c/c horizontally, one tie per storey height vertically.

Key Points to Watch


Timber frame dwellings should comply with the requirements of I.S. 440 Timber frame construction, dwellings and other buildings.

Diagram 18 WT 4A Twin leaf timber frame without sheathing - Flanking requirements for an external (flanking) wall
(Par. 3.6.3)

(i) External wall junction

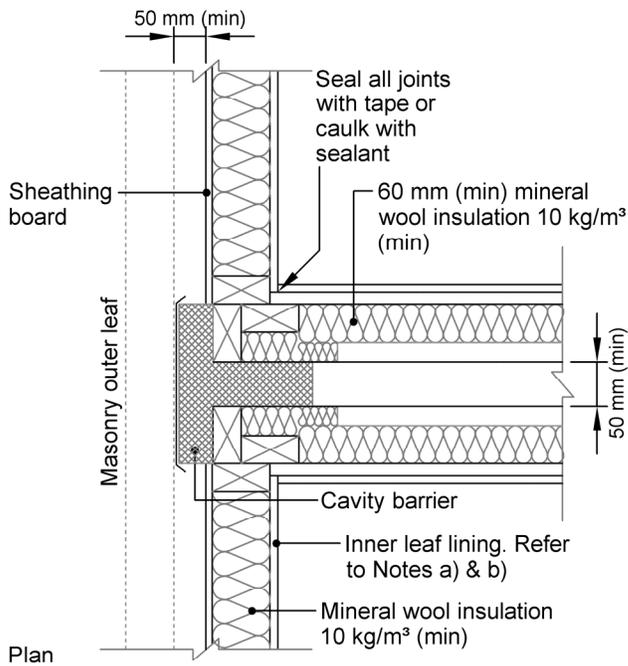

(ii) Staggered wall junction

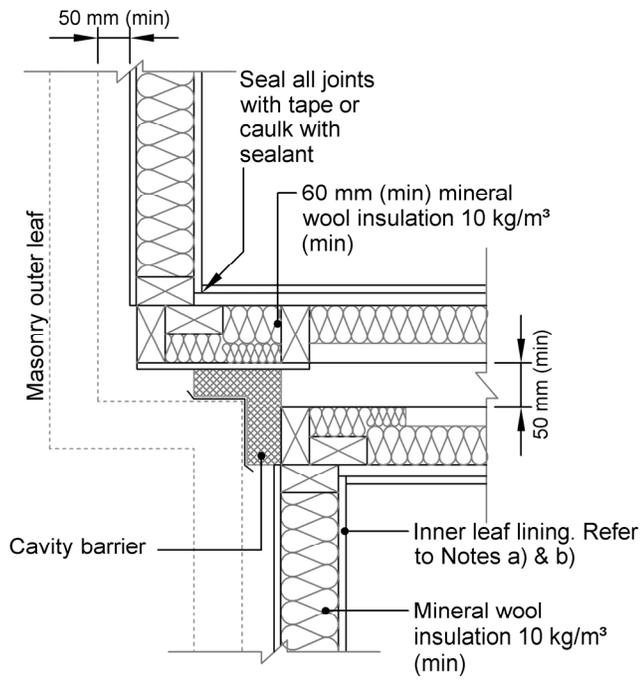

Flanking wall requirements

The wall finish on the flanking wall (inner leaf of the external wall) should be:

- a) one layer of plasterboard with a minimum mass per unit area of 10 kg/m², or
- b) in buildings with separating floors two layers of plasterboard (staggered joints) should be used (minimum mass per unit area of 10 kg/m²).


Where the external wall is a cavity wall:

- c) the outer masonry leaf should be 100 mm (min) thick.
- d) the cavity should be 50 mm (min).
- e) the cavity should be stopped between the ends of the separating wall and the outer leaf with a flexible cavity barrier.

Key Points to Watch

- Ensure that all cavity barriers are flexible and are fixed to one frame only.
- Seal all perimeter joints of plasterboard with tape or caulk with sealant.


Diagram 19 WT 4A Twin leaf timber frame without sheathing - Key junction details
 (1 of 3)
 (Par. 3.6.3)

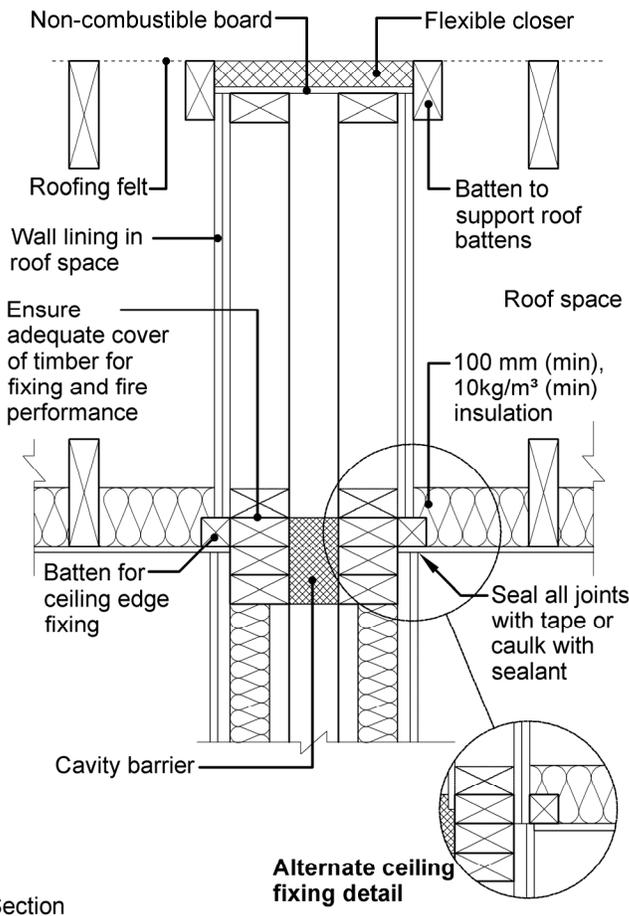

A) Junction with ceilings and roof spaces

Key Points to Watch

- The separating wall should be continuous to the underside of the roof.
- The junction between the separating wall and the roof should be filled with a flexible closer.
- The junction between the ceiling and the wall linings should be sealed with tape or caulked with a sealant.
- Where there is an external wall the cavity should be closed at eaves level with a suitable material.
- Cavity barrier should fill the cavity and be tight to the vertical cavity barrier at the ends of separating wall and to non-combustible board.
- Ensure that cavity barrier covers horizontal joints between wall members.
- Wall lining in roof space to consist of a minimum 2 layers of gypsum based board with a total mass per unit area of 16 kg/m²(min), both sides, all joints staggered.

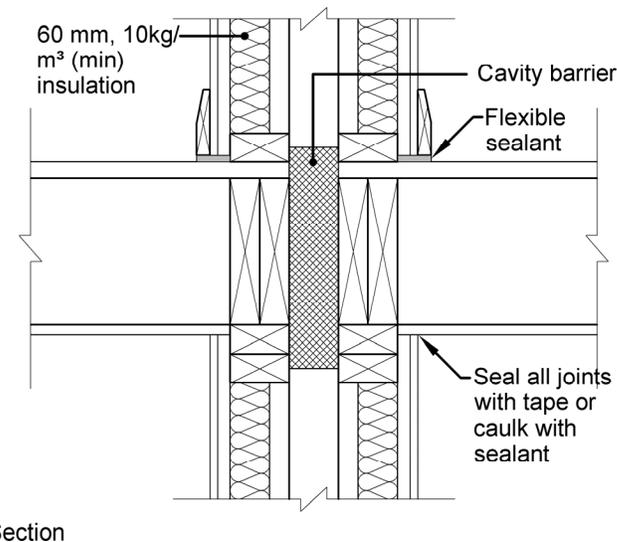


B) Junction with internal floor

Key Points to Watch

- Block the air paths through the wall into the cavity by using full depth solid timber blockings or continuous header joist where joists span at right angles to the wall.
- Internal floors should not be continuous between dwellings.
- Cavity barrier should fill the cavity and be tight to the vertical cavity barrier at the ends of separating wall and to non-combustible board.
- Ensure that the cavity barrier covers horizontal joints between wall members.

Diagram 20 WT 4A Twin leaf timber frame without sheathing - Key junction details
(2 of 3)
(Par. 3.6.3)


A) Ground floor junction with ground bearing slab

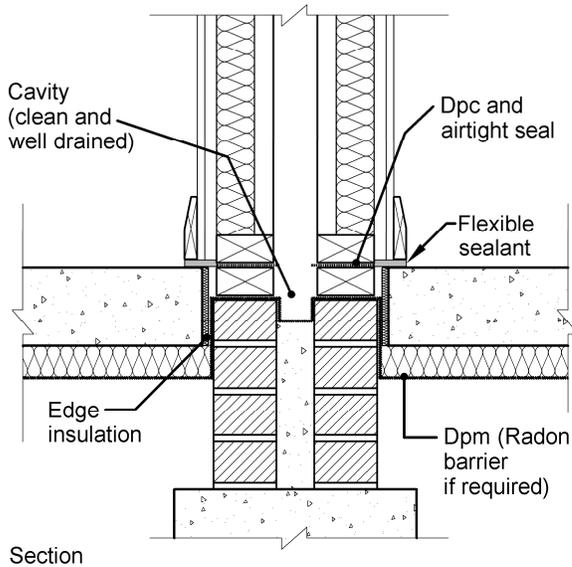

Key Points to Watch

- The ground floor should not be continuous between dwellings.

B) Ground floor junction with suspended timber ground floor

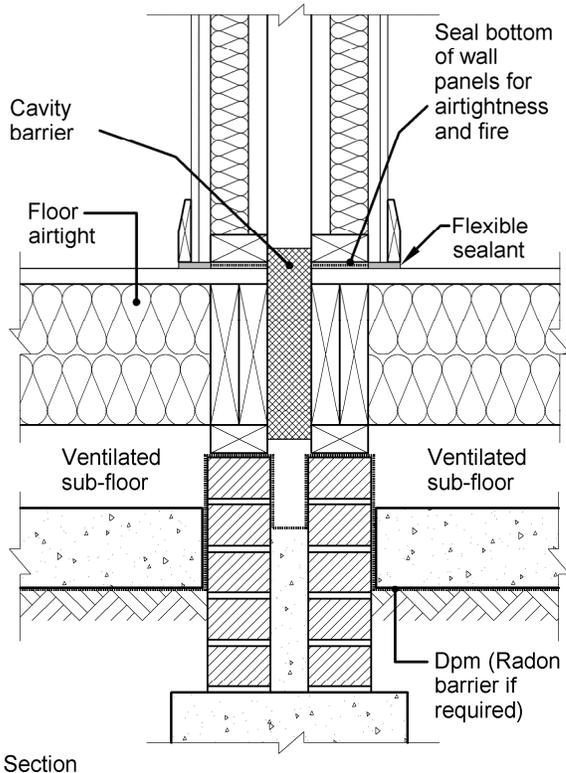

Key Points to Watch

- The ground floor should not be continuous between dwellings.
- Close spaces between floor joists with full depth timber blocking where joists are at right angles to the wall.
- Floor decking may run under sole plates.

Diagram 21 WT 4A Twin leaf timber frame without sheathing - Key junction details
(3 of 3)
(Par. 3.6.3)


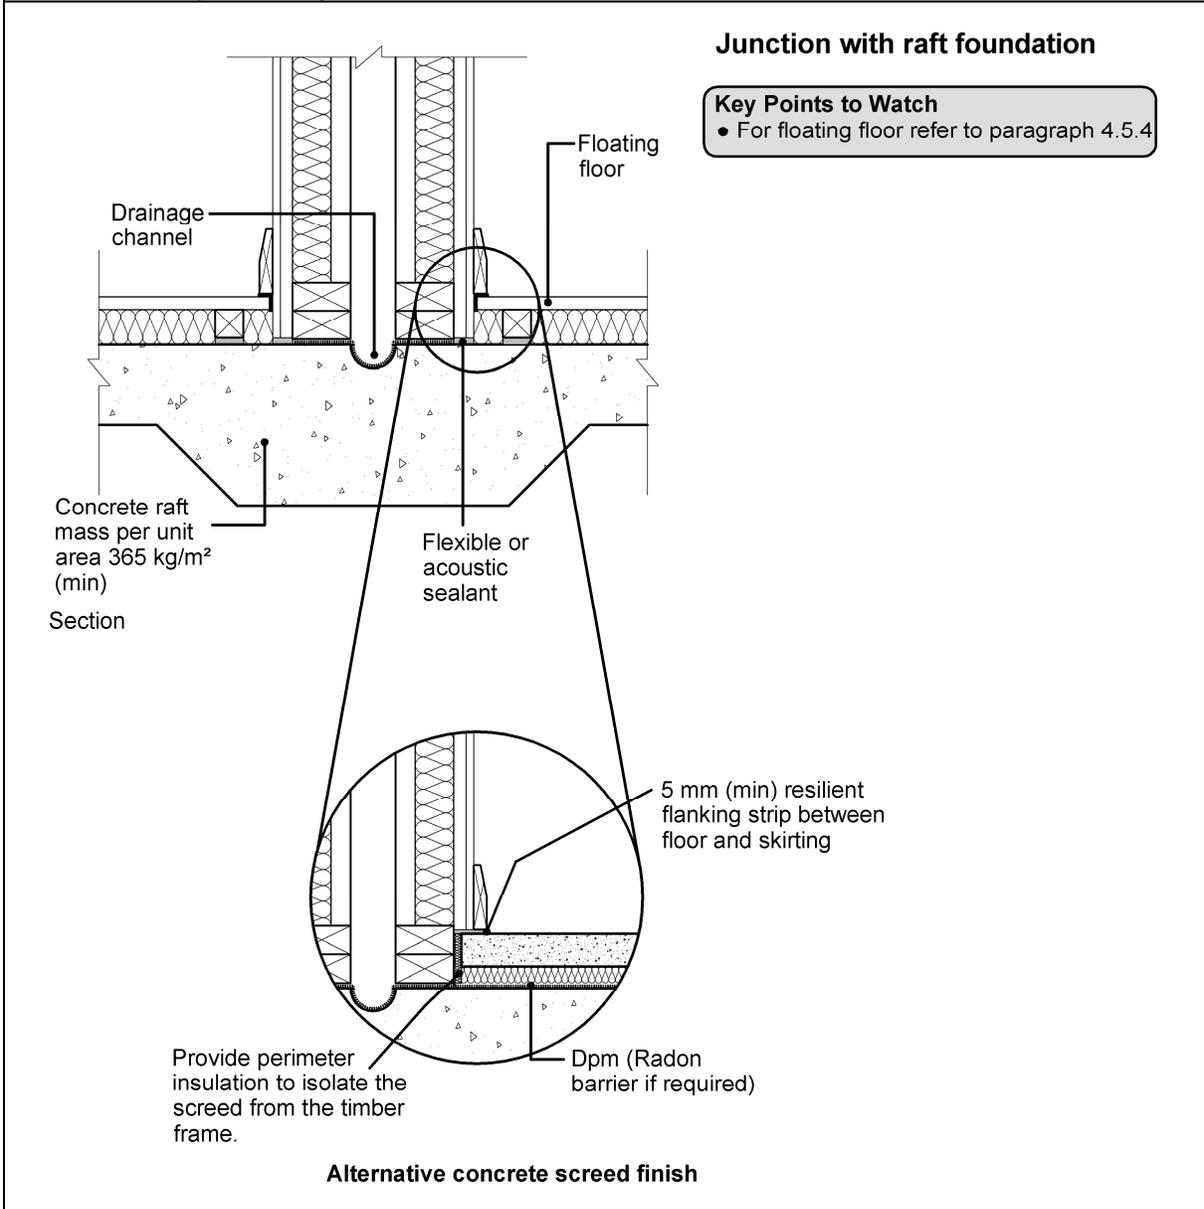


Diagram 22 WT 4A Twin leaf timber frame without sheathing - Services and sockets in separating walls
(Par. 3.6.3)

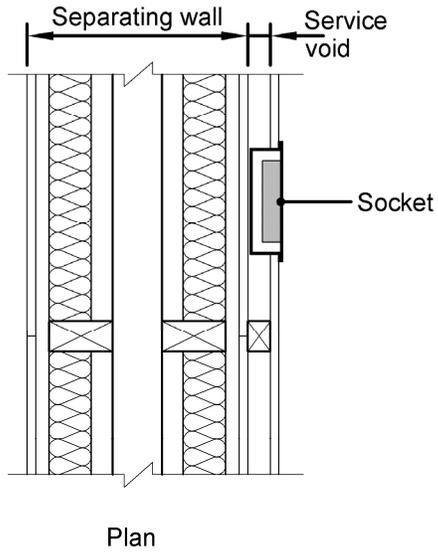


Key Points to Watch


- **DO NOT** locate services and sockets in the separating wall. Where this is unavoidable (e.g. in a kitchen) provide a service void on the surface of the separating wall.
- Studs or battens used to create the service zone should be securely fixed back to the separating wall structure.

Diagram 23 WT 4B Twin leaf timber frame with sheathing- - Flanking requirements for an external (flanking) wall
(Par. 3.6.3)

(i) External wall junction

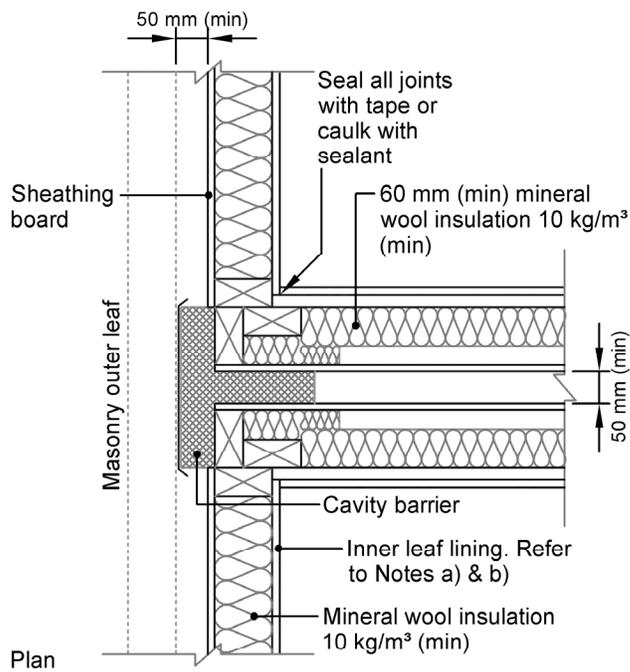

(ii) Staggered wall junction

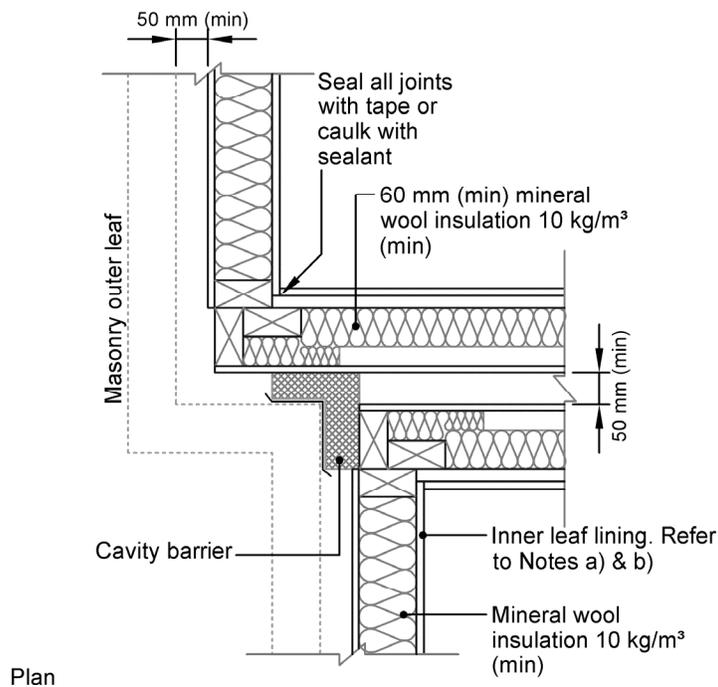

Flanking wall requirements

The wall finish on the flanking wall (inner leaf of the external wall) should be:

- a) one layer of plasterboard with a minimum mass per unit area of 10 kg/m^2 , or
- b) in buildings with separating floors two layers of plasterboard (staggered joints) should be used (minimum mass per unit area of 10 kg/m^2).


External wall requirements

- c) the outer leaf should be 100 mm (min) thick masonry.
- d) the cavity should be 50 mm (min).
- e) the cavity should be stopped between the ends of the separating wall and the outer leaf with a flexible cavity barrier.

Key Points to Watch

- Ensure that all cavity barriers are flexible and are fixed to one frame only.
- Seal all perimeter joints of plasterboard with tape or caulk with sealant.


Diagram 24 WT 4B Twin leaf timber frame with sheathing - Key junction details (1 of 3)
 (Par. 3.6.3)

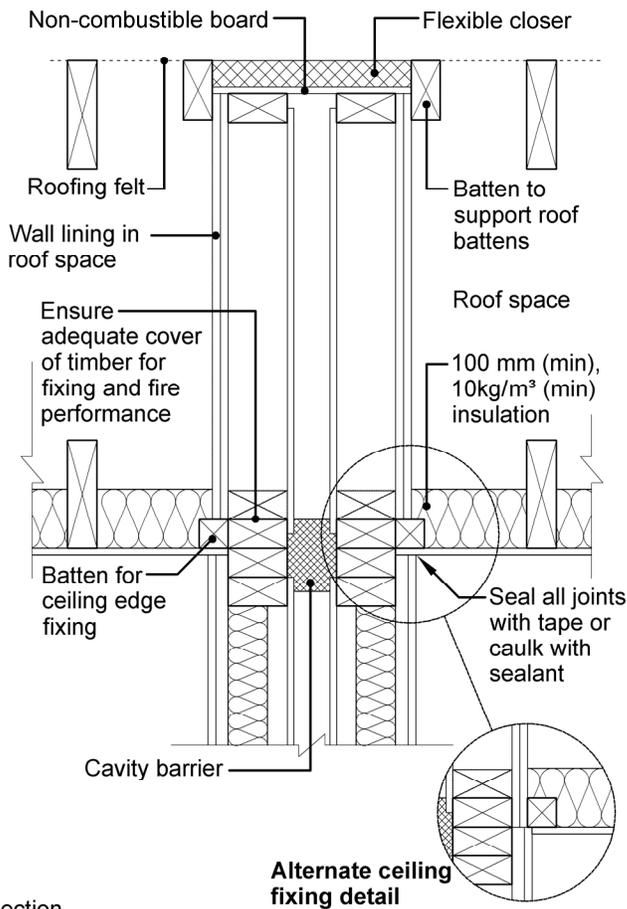

A) Junction with ceilings and roof spaces

Key Points to Watch

- The separating wall should be continuous to the underside of the roof.
- The junction between the separating wall and the roof should be filled with a flexible closer.
- The junction between the ceiling and the wall linings should be sealed with tape or caulked with a sealant.
- Where there is an external wall the cavity should be closed at eaves level with a suitable material.
- Cavity barriers should fill the cavity and be tight to the vertical cavity barrier at the ends of separating wall and to non-combustible board.
- Ensure that cavity barrier covers horizontal joints between wall members.
- Wall lining in roof space to consist of a minimum 2 layers of gypsum based board with a total mass per unit area of 16 kg/m²(min), both sides, all joints staggered.

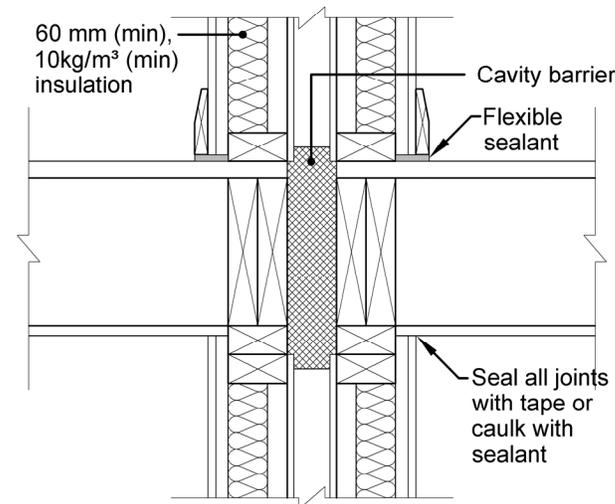


B) Junction with internal floor

Key Points to Watch

- Block the air paths through the wall into the cavity by using full depth solid timber blockings or continuous header joist where joists span at right angles to the wall.
- Internal floors should not be continuous between dwellings.
- Cavity barrier should to fill the cavity and be tight to the vertical cavity barrier at the ends of separating wall and to non-combustible board.
- Ensure that the cavity barrier covers horizontal joints between wall members.

Diagram 25 WT 4B Twin leaf timber frame with sheathing - Key junction details (2 of 3)
 (Par. 3.6.3)


A) Ground floor junction with ground bearing slab

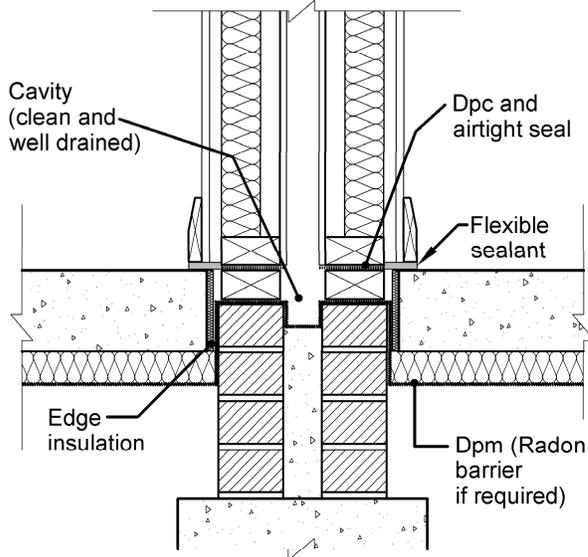

Key Points to Watch

- The ground floor slab should not be continuous between dwellings.

B) Ground floor junction with suspended timber ground floor

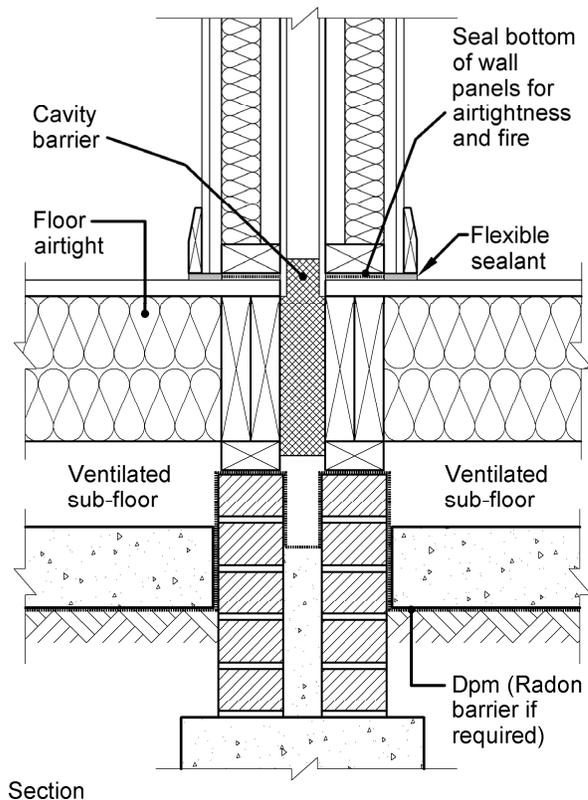

Key Points to Watch

- The timber ground floor should not be continuous between dwellings.
- Close spaces between floor joists with full depth timber blocking where joists are at right angles to the wall.
- Floor decking may run under sole plates.

Diagram 26 WT 4B Twin leaf timber frame with sheathing - Key junction details (3 of 3)
(Par. 3.6.3)


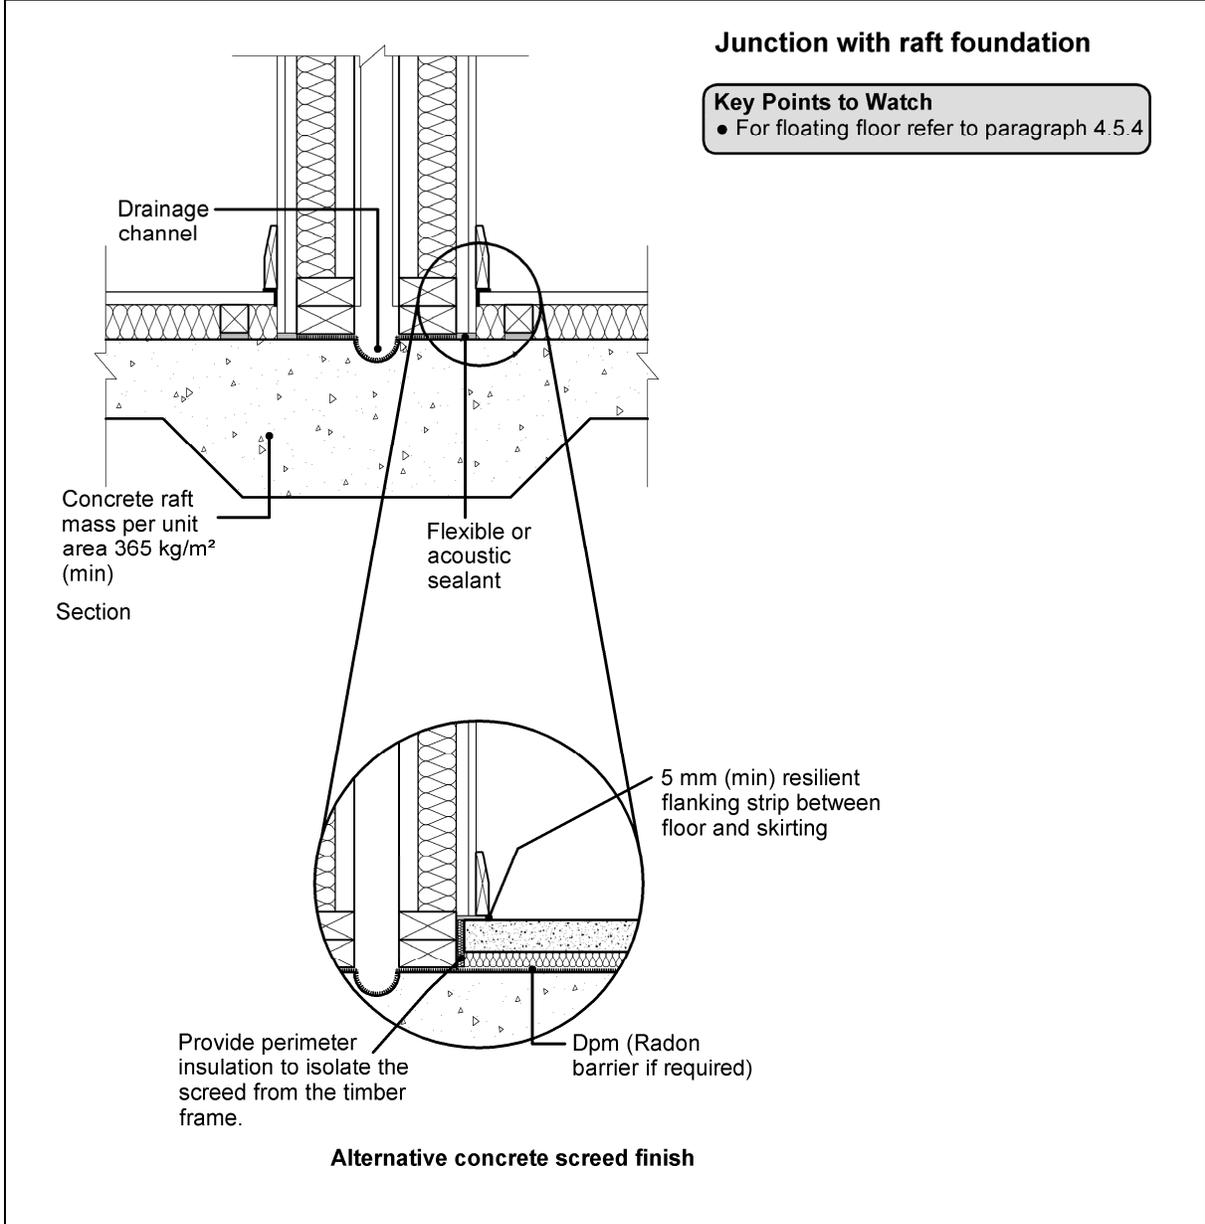


Diagram 27 WT 4B Twin leaf timber frame with sheathing - Services and sockets in separating walls
(Par. 3.6.3)

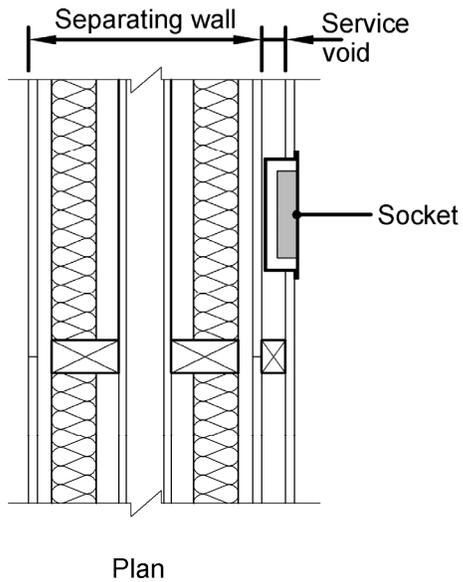

Key Points to Watch

- **DO NOT** locate services and sockets in the separating wall. Where this is unavoidable (e.g. in a kitchen) provide a service void on the surface of the separating wall.
- Studs or battens used to create the service zone should be securely fixed back to the separating wall structure.

Section 4

Separating floors and associated flanking construction details

4.1 Separating floor construction

4.1.1 General

4.1.1.1 This section gives examples of floor types which, if constructed correctly, should achieve the performance level set out in Table 1.

NOTE: *Impact sound requirements may not be applicable to all separating floors, see Diagram 1.*

4.1.2 Types of floors

4.1.2.1 The floors are grouped into three main types as follows (refer to Diagram 28).

4.1.2.2 Floor Type 1 (FT 1) - Resilient material bonded to concrete base with ceiling under.

The resistance to airborne sound depends mainly on the mass per unit area of the concrete base and partly on the mass per unit area of the ceiling. The resilient material bonded to the concrete base reduces impact sound at source, see Diagram 28 (a).


4.1.2.3 Floor Type 2 (FT 2) – Floating layer on concrete base with ceiling under.

The resistance to airborne sound depends on the mass per unit area of the concrete base, and partly on the mass per unit area of the floating layer. The floating layer also reduces the transmission of impact sound to the concrete base and to the surrounding construction, see Diagram 28 (b).


4.1.2.4 Floor Type 3 (FT 3) - Floating layer on timber base with ceiling under.

The resistance to airborne sound depends partly on the mass of the timber base and the absorbent blanket and partly on the mass of the floating layer. The floating layer reduces the transmission of impact sound to the timber base and to the surrounding construction. A timber floor needs less mass than a concrete floor because the material is softer and radiates sound less efficiently, see Diagram 28 (c).


Diagram 28 Types of floors
(Par. 4.1.2)

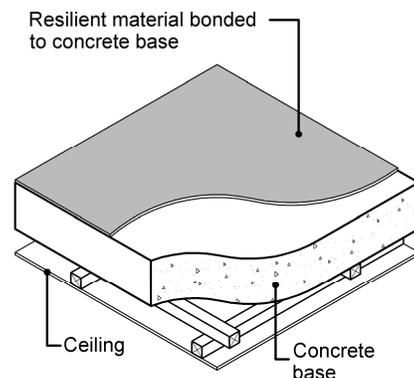

(a) FT 1 Resilient material bonded to concrete base with ceiling

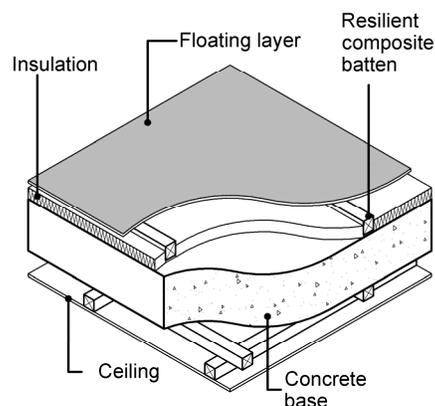

(b) FT 2 Floating layer on concrete base with ceiling

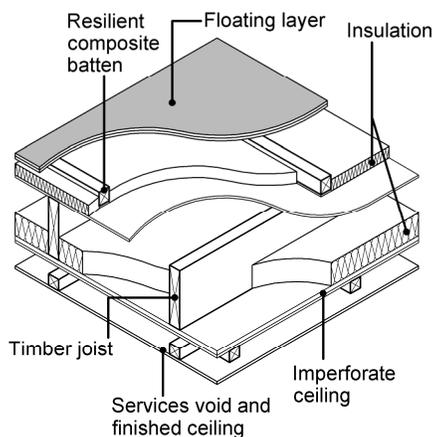

(c) FT 3 Floating layer on timber base with ceiling

4.2 Flanking provisions

4.2.1 General

4.2.1.1 In order for the floor construction to be fully effective, care should be taken to correctly detail the junctions between the separating floor and other elements such as external walls, separating walls and floor penetrations.

4.2.2 Junctions between separating floors and other building elements

4.2.2.1 Guidance is given below to control flanking transmission at the junction of the separating floor types and other building elements.

4.2.2.2 In addition, Table 5 outlines the illustrations provided in this document of the junctions that may occur between each of the three separating floor types discussed in 4.1.2 and the various attached building elements.

4.3 Ceiling treatments

4.3.1 General

4.3.1.1 Reasonable sound insulation is dependent on an appropriate ceiling being provided. Paragraphs 4.3.2 and 4.3.3 show example ceiling treatments for concrete and timber separating floors. Use of a better performing ceiling than that described in this guidance should improve the sound insulation of the floor provided there is no significant flanking transmission.

NOTE: *The mass per unit area of a sub ceiling should not be included in the calculation of the mass per unit area of the floor.*

4.3.2 Example ceiling treatment for a concrete separating floor

4.3.2.1 Plasterboard on timber battens and/or counter battens.

The following specification should be met:

- Create a ceiling void to the underside of the concrete floor using a single layer of plasterboard with a mass per unit area of 10 kg/m² (min), fixed to timber battens and/or counter battens or proprietary resilient channels/ metal ceiling systems;

NOTE: *The sound insulation performance of all ceiling treatments is increased if an absorbent layer of 25 mm (min) mineral wool with a density of 10 kg/m³ (min) that covers the ceiling board area.*

4.3.2.2 Electric cables give off heat when in use and special precautions may be required when they are covered by thermally insulating materials. Refer to BRE BR 262, Thermal Insulation: avoiding risks, section 2.4.

4.3.2.3 Installing recessed light fittings in ceilings can reduce their resistance to the passage of airborne and impact sound.

4.3.3 Example ceiling treatment for a timber separating floor

4.3.3.1 Plasterboard on timber battens and/or counter battens.

The following specification should be met:

- Minimum thickness of 30 mm plasterboard imperforate ceiling in two layers with joints staggered, fixed to timber joists to form fire resisting ceiling;
- Provide a sub-ceiling consisting of a single layer of plasterboard with a mass per unit area 10 kg/m² (min) fixed to the imperforate ceiling using timber battens and/ or counter battens or proprietary resilient channels.

4.3.3.2 Installing recessed light fittings in ceilings can reduce their resistance to the passage of airborne and impact sound.

4.3.3.3 Fire resisting ceilings in a timber separating floor should not normally be penetrated without specific fire design complying with Part B – Fire Safety. Therefore, it is recommended that a sub-ceiling should be provided below the fire resisting ceiling in order to accommodate services, electric cable runs etc.

4.4 Floor treatments

4.4.1 General

4.4.1.1 Each floor type should use an appropriate floor treatment. This section details three specific floor treatments. Alternative floating floor constructions may be adopted by following the performance based approach in paragraph 4.5.

NOTE: *The mass per unit area of a floor treatment should not be included in the calculation of the mass per unit area of the floor.*

4.4.1.2 Where proprietary acoustic products are used, they should be installed strictly in accordance with the manufacturer's recommendations.


4.4.2 Resilient material

4.4.2.1 A resilient material is a material which returns to its original thickness after it has been compressed. Resilient material appropriate for impact sound is a resilient material, or material with a resilient base, with an overall uncompressed thickness of at least 4.5 mm. A material less than 4.5 mm may be suitable where it consists of a resilient covering with a weighted reduction in impact sound pressure level (ΔL_w) of not less than 17 dB when measured in accordance with I.S. EN ISO 717-2.

NOTE: *Products which do not form part of the permanent works and can be readily removed, e.g. carpet, underlay etc are not appropriate for use as resilient layers.*

4.4.3 Impact sound reduced at source for FT 1 concrete separating floors

4.4.3.1 Resilient material bonded to concrete base. A resilient material as described in paragraph 4.4.2.1 should be bonded to the concrete floor and will reduce impact sound at source (see Diagram 29).

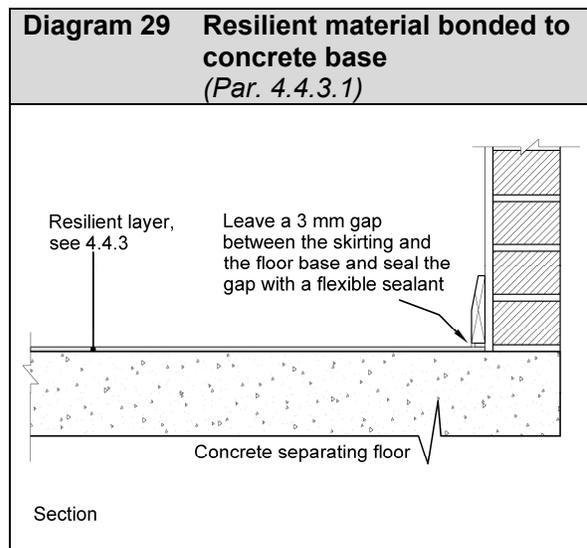

4.4.4 Floating floors

4.4.4.1 A floating floor should isolate the finished floor from the base and reduce impact sound.

4.4.5 Example floating floor suitable for use with a FT 2 concrete separating floor

4.4.5.1 *Timber raft of board material fixed to resilient layer laid on top of the concrete floor, (see Diagram 30)*


The following specification should be met:

- timber raft of board material (with bonded edges, e.g. tongued and grooved) of thickness 18 mm (min) and mass per unit area of 12 kg/m² (min) fixed to resilient composite battens of 45 mm (min) deep to meet the performance requirements in paragraph 4.4.2. The resilient layer must be continuous and

pre-bonded to the bottom of the batten, and

- provide 45 mm (min) mineral wool quilt with 10-36 kg/m³ laid between battens.

Diagram 30 Timber raft of board material fixed to resilient layer laid on top of the concrete floor.
(Par. 4.4.5.1)

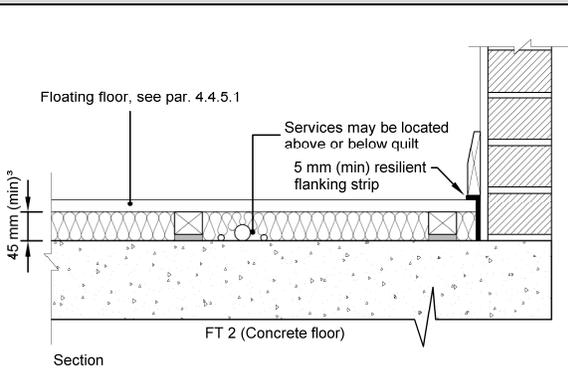

General notes applicable to all floating floor treatments:

1. All floor treatments must be installed in accordance with the manufacturer's instructions.
2. Provide 5 mm (min) resilient flanking strips around the perimeter of the flooring boards to isolate floor from walls and skirting.
3. Void dimension indicated when floor is loaded to 25 kg/m².
4. Services, where required, may be located above or below the quilt.
5. Ensure services, where provided, do not bridge the resilient layer.


4.4.6 Example floating floors suitable for use with a timber base separating floor

4.4.6.1 Timber raft of board material fixed to resilient layer, laid on top of a timber base separating floor, (see Diagram 31)

The following specification should be met:

- floating layer of 18 mm (min) thick timber or wood-based board with tongue and grooved edges with all joints glued and spot bonded to a substrate of 19 mm (min) plasterboard, or material with at least the same mass secured to:
- resilient composite battens 70 mm (min) deep complying with performance requirements of 4.4.2. The resilient layer of the batten must be continuous and pre-bonded to the bottom of the batten;
- provide 60 mm (min) mineral wool quilt with a density of 10-36 kg/m³ laid between battens.

Diagram 31 Floating floor treatment suitable for Floor Type 3 (FT 3)
(Par. 4.4.6.1)

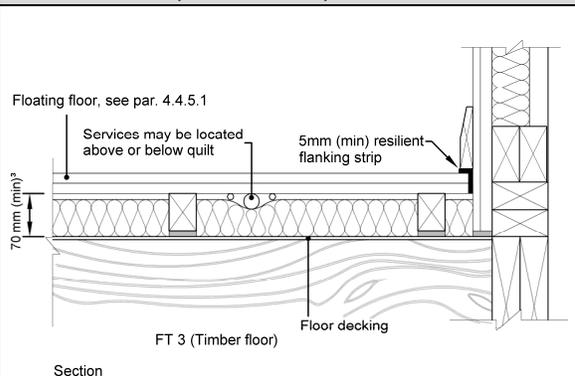

General notes applicable to all floating floor treatments:

1. All floor treatments must be installed in accordance with the manufacturer's instructions.
2. Provide 5 mm (min) resilient flanking strips around the perimeter of the flooring boards to isolate floor from walls and skirting.
3. Void dimension indicated when floor is loaded to 25 kg/m².
4. Services, where required, may be located above or below the quilt.
5. Ensure services, where provided, do not bridge the resilient layer.

4.5 Performance based approach

4.5.1 Where a floating floor treatment other than 4.4.5 or 4.4.6 is used, it should consist of a rigid boarding above a resilient layer and /or damping layer; with a weighted reduction in impact sound pressure level (ΔL_w) of not less than 29dB when measured according to I.S. EN 10140-3 and rated according to I.S. EN ISO 717-2 (refer to Annex B: Supplementary guidance on acoustics

measurement standards). The performance value ΔL_w should be achieved when the floating floor is loaded and unloaded as described in I.S. EN ISO 10140 for category II systems.

Table 5 Reference table to illustrations provided on separating floor junctions (Par 4.2.2.2)			
	Separating Floor Type		
	FT 1 <i>Resilient material bonded to concrete base with ceiling under</i> (Diagram 32)	FT 2 <i>Floating layer on concrete base with ceiling under</i> (Diagram 37)	FT 3 <i>Floating layer on timber base with ceiling under</i> (Diagram 42)
Separating Wall Type²			
WT 1 <i>Solid masonry / concrete with plaster finish</i> (Diagram 4)	Diagram 34A	Diagram 39A	Not applicable
WT 2 <i>Solid masonry with dry lining</i> (Diagram 8)	Diagram 34B	Diagram 39B	Not applicable
WT 3 <i>Cavity masonry with plaster finish</i> (Diagram 12)	Diagram 35	Diagram 40	Not applicable
WT 4A <i>Twin leaf timber frame without sheathing</i> (Diagram 17A)	Not applicable	Not applicable	Diagram 44A
WT 4B <i>Twin leaf timber frame with sheathing</i> (Diagram 17B)	Not applicable	Not applicable	Diagram 44B
Flanking requirements			
External wall	Diagram 33	Diagram 38	Diagram 43
Service penetrations	Diagram 36	Diagram 41	Diagram 45
NOTES:			
1. The illustrations and guidance are provided to enable compliance with Part E only. It should be noted that all elements incorporated into the building works must comply with all relevant parts of the Building Regulations.			
2. Where separating walls are used, reference should be made to Section 3, Table 4 for associated flanking construction details.			

4.6 Floor Type 1 (FT 1) - Resilient material bonded to concrete base with ceiling under.

4.6.1 General

4.6.1.1 The resistance to airborne sound depends mainly on the mass per unit area of the concrete base and partly on the mass per unit area of the ceiling. The resilient layer reduces impact sound at source.

4.6.2 Floor specification

4.6.2.1 Two FT 1 constructions are described in Diagram 32.


4.6.3 Key junctions and flanking details

4.6.3.1 Details of how junctions with FT 1 should be constructed to limit flanking transmission are described in Diagrams 33 to 36.

Diagram 32 FT 1 Resilient material bonded to concrete base with ceiling under - Specification
(Par. 4.6.2)

A) FT 1A - Solid concrete floor

Resilient material bonded to the concrete floor slab, see par. 4.4.3

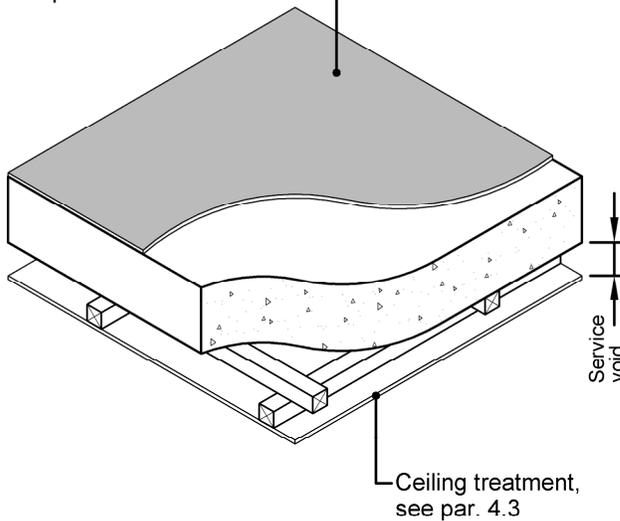

Specification

The mass per unit area of the concrete base (including shuttering only if it is solid concrete or metal) should be 365 kg/m² (min).

Example

Resilient material (see par. 4.4.3) bonded to 200 mm deep concrete floor slab. Provide a ceiling (see par. 4.3.2) to the underside of the concrete floor slab.


Key Points to Watch

- Ensure the concrete density is 2400 kg/m³ (min)
- Fill all voids between separating wall and separating floor.
- Ensure resilient material is fully bonded to the floor slab.

B) FT 1B - Precast concrete hollowcore floor

Fill all joints between planks with mortar

Resilient material bonded to screed, see par. 4.4.3

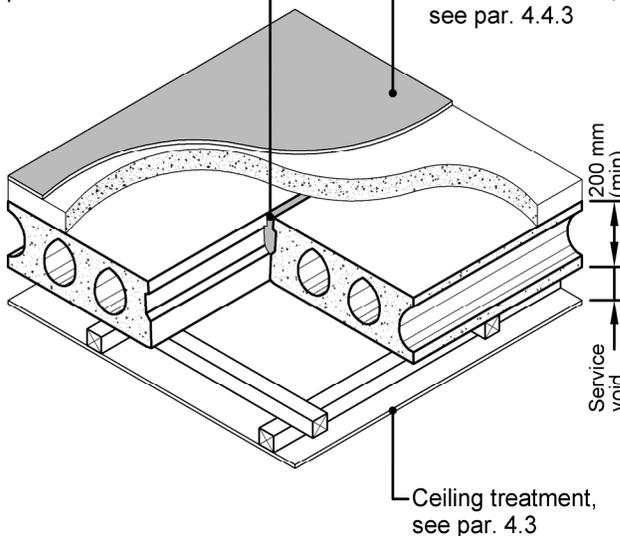

Specification

The mass per unit area of the concrete base (including floor screed) should be 365 kg/m² (min).


Example

Resilient material (see par. 4.5.3) bonded to 65 mm (min) screed on 200 mm (min) deep precast concrete floor planks. Provide a ceiling (see par. 4.3.2) to the underside of the concrete floor slab.

Key Points to Watch

- Butt planks tightly together and grout all joints between planks.
- Fill all voids between separating wall and separating floor.
- Ensure resilient material is fully bonded to the screed surface.

Diagram 33 FT 1 Resilient material bonded to concrete base with ceiling under - Flanking requirements
(Par. 4.6.3)

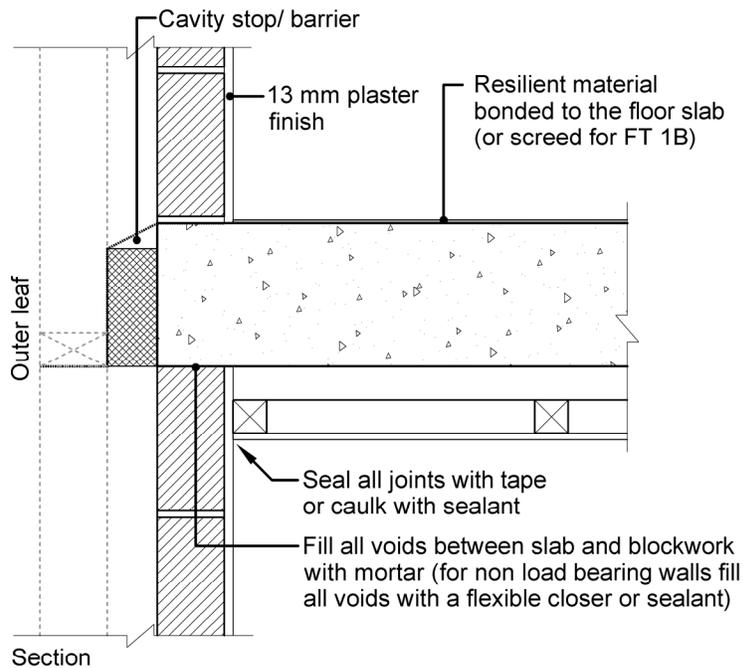

Flanking wall requirements

The flanking wall should be of masonry construction and should have a mass per unit area of at least 120 kg/m² (excluding any finish).


Where the external wall is a cavity wall:

- a) the outer leaf may be of any construction.
- b) the cavity should be stopped with a flexible closer to minimise sound transmission along the cavity unless the cavity is fully filled with mineral wool or expanded polystyrene beads (seek manufacturers advice for other suitable materials).

Key Points to Watch

- The floor base should be built into a cavity masonry external wall and carried through to the cavity face of the inner leaf.
- If hollow core planks are used, the ends of the cores should be sealed with concrete at the separating wall junction.
- The cavity stop should be protected from moisture transfer across the cavity.

Diagram 34 FT 1 Resilient material bonded to concrete base with ceiling under – Key junction details (1 of 2)
(Par. 4.6.3)

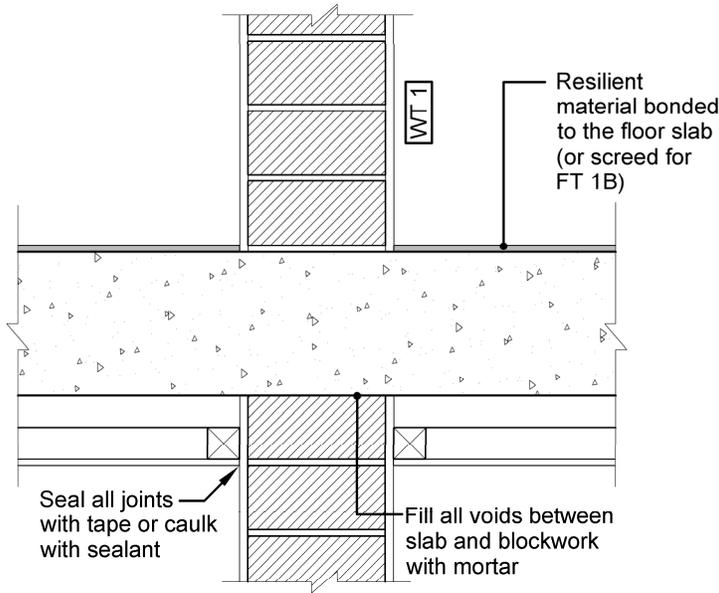


Section

A) Junction between FT 1 and WT 1

Key Points to Watch

- Where a FT 1A floor (solid concrete) is used, either the wall or floor may be continuous.
- Where a FT 1B floor (precast hollowcore floor) is used, the floor slab should not be continuous through WT 1. The cores should be sealed with mortar at the separating wall junction.

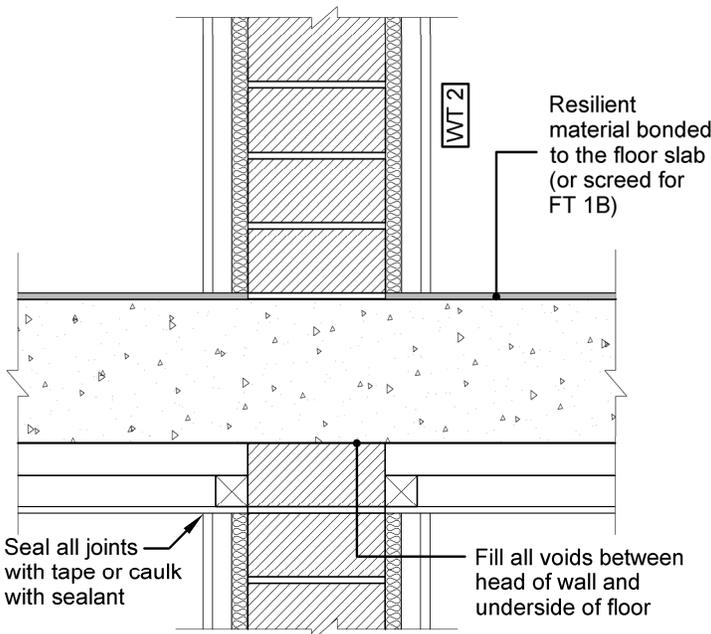


Section

B) Junction between FT 1 and WT 2

Key Points to Watch

- Where a FT 1A floor (solid concrete) is used, either the wall or floor may be continuous.
- Where a FT 1B floor (precast hollowcore floor) is used, the floor slab should not be continuous through WT 2. The cores should be sealed with mortar at the separating wall junction.

Diagram 35 FT 1 Resilient material bonded to concrete base with ceiling under – Key junction details (2 of 2)
(Par. 4.6.3)

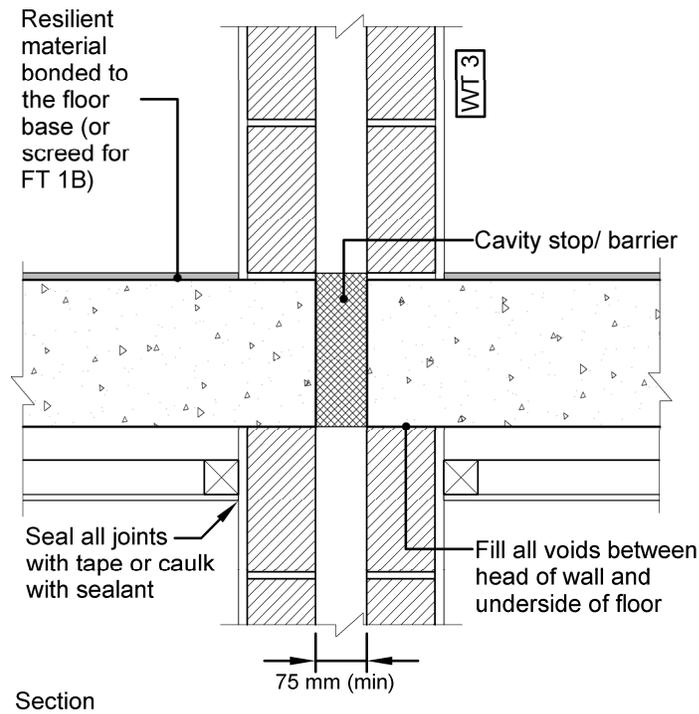


Junction between FT 1 and WT 3

Key Points to Watch

- The floor base should be carried through to the cavity face of the inner leaf.
- The wall cavity should not be bridged (except for wall ties).
- If hollow core planks are used, the ends of the cores should be sealed with concrete at the separating wall junction.

Diagram 36 FT 1 Resilient material bonded to concrete base with ceiling under - Services
(Par. 4.6.3)

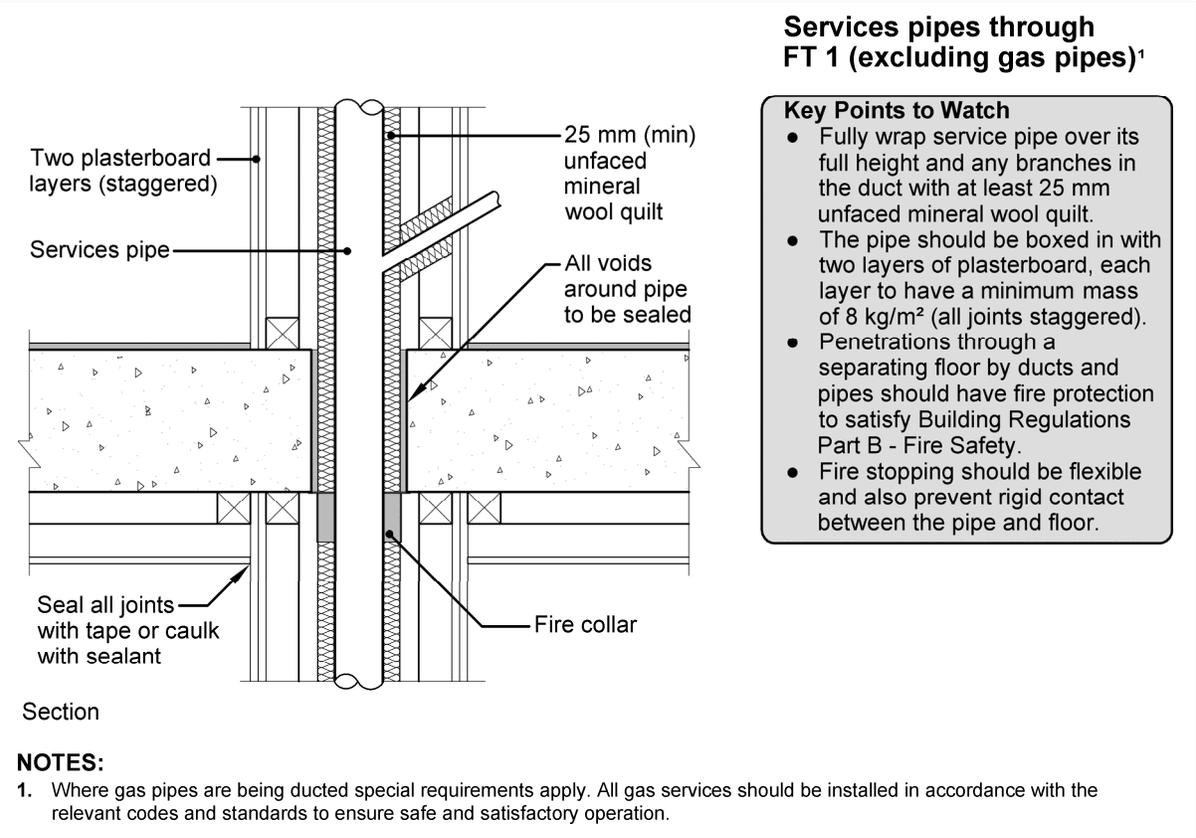

4.7 Floor Type 2 (FT 2) - Floating layer on concrete base with ceiling under.

4.7.1 General

4.7.1.1 The resistance to airborne and impact sound depends on the mass per unit area of the concrete base, as well as the mass per unit area and isolation of the floating layer and the ceiling. The floating layer reduces the transmission of impact sound to the base and to the surrounding construction.

4.7.2 Floor specification


4.7.2.1 Two FT 2 constructions are described in Diagram 37.

4.7.3 Key junctions and flanking details

4.7.3.1 Details of how junctions with FT 2 should be constructed to limit flanking transmission are described in Diagrams 38 to 41.

Diagram 37 FT 2 Floating layer on concrete base with ceiling under – Specification
(Par. 4.7.2)

A) FT 2A - Solid concrete floor

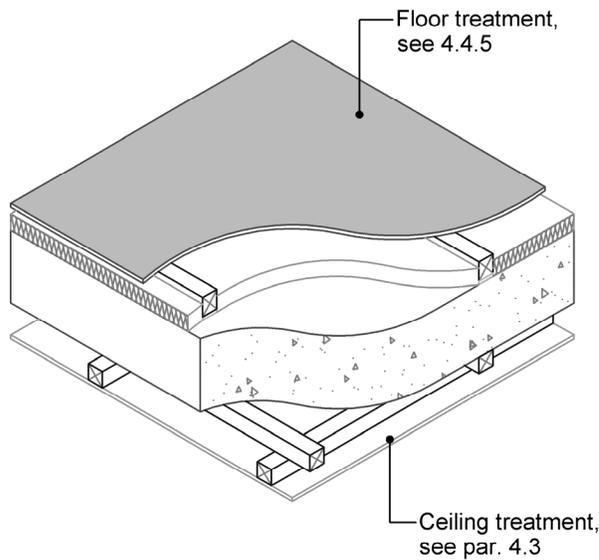

Specification

The mass per unit area of the floor (including shuttering only if it is solid concrete or metal) should be 365 kg/m² (min).


Example

Floor Treatment (see par. 4.4.5) laid on 200 mm deep concrete floor slab. Provide a ceiling (see par. 4.3.2) to underside of the concrete floor slab.

Key Points to Watch

- Ensure the concrete density is 2400 kg/m³ (min).
- Fill all voids between separating wall and separating floor.

B) FT 2B - Precast concrete hollowcore floor

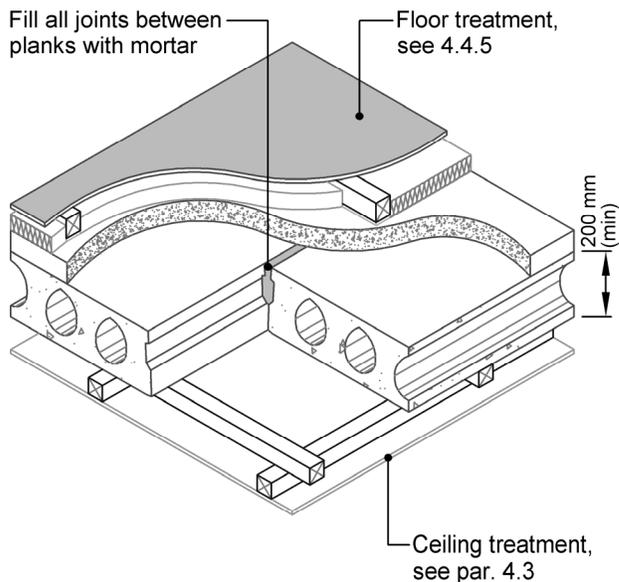

Specification

The mass per unit area of the concrete base (including floor screed) should be 365 kg/m² (min).


Example

Floor Treatment (see par. 4.4.5) laid on 65 mm (min) screed on 200 mm deep precast hollowcore concrete floor planks. Provide a ceiling (see par. 4.3.2) to the underside of the concrete floor slab.

Key Points to Watch

- Butt planks tightly together and grout all joints between planks.
- Fill all voids between separating wall and separating floor.

Diagram 38 FT 1 Floating layer on concrete base with ceiling under – Flanking requirements
(Par. 4.7.3)

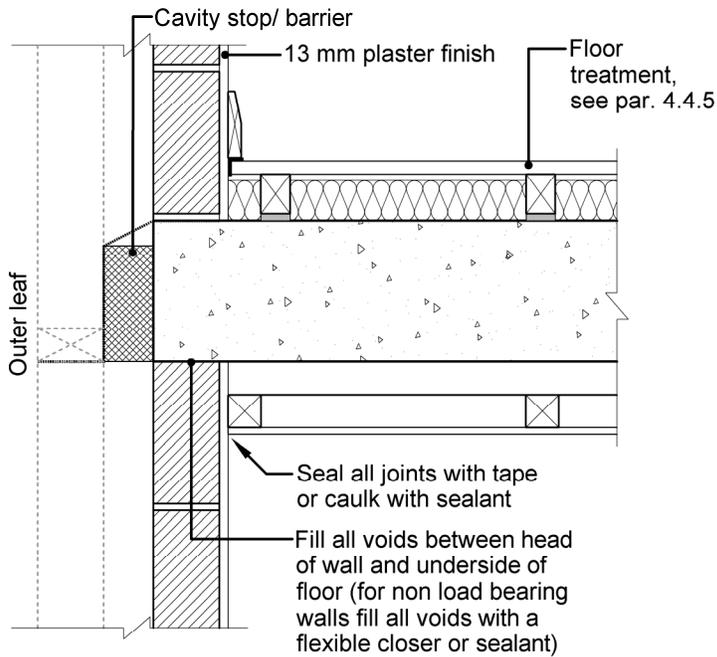

Flanking wall requirements

The flanking wall should be of masonry construction and should have a mass per unit area of at least 120 kg/m² (excluding any finish).


Where the external wall is a cavity wall:

- a) the outer leaf may be of any construction.
- b) the cavity should be stopped with a flexible closer to minimise sound transmission along the cavity unless the cavity is fully filled with mineral wool or expanded polystyrene beads (seek manufacturers advice for other suitable materials).

Key Points to Watch

- The floor base should be built into a cavity masonry external wall and carried through to the cavity face of the inner leaf.
- If hollow core planks are used, the ends of the cores should be sealed with concrete at the separating wall junction.
- Install flanking strips around the perimeter of the flooring treatment to isolate the floating floor from the walls and skirting.
- The cavity stop should be protected from moisture transfer across the cavity.

**Diagram 39 FT 2 Floating layer on concrete base with ceiling under –
Key junction details (1 of 2)**
(Par. 4.7.3)

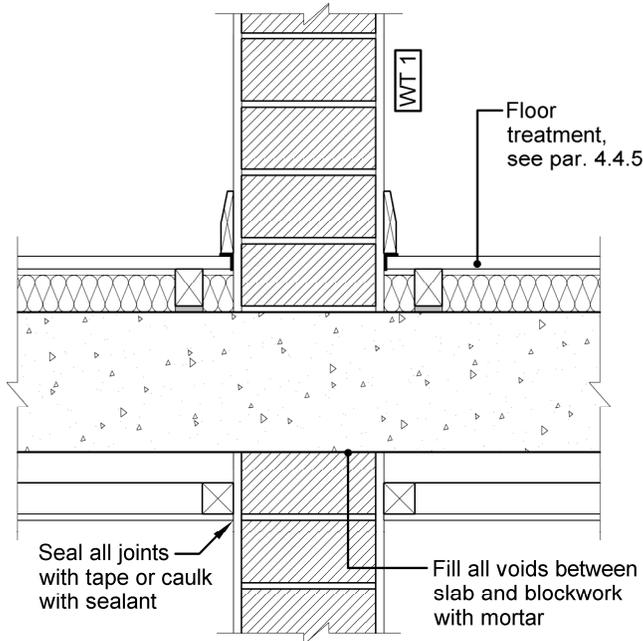


Section

A) Junction between FT 2 and WT 1

Key Points to Watch

- Where a FT 2A floor (solid concrete) is used, either the wall or floor may be continuous.
- Where a FT 2B floor (precast hollowcore floor) is used, the floor slab should not be continuous through WT 1. The cores should be sealed with mortar at the separating wall junction.

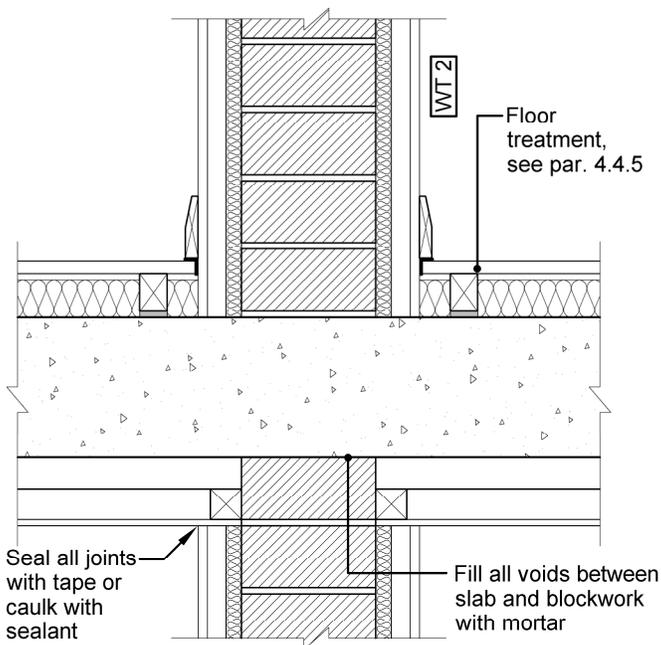


Section

B) Junction between FT 2 and WT 2

Key Points to Watch

- Where a FT 2A floor (solid concrete) is used, either the wall or floor may be continuous.
- Where a FT 2B floor (precast hollowcore floor) is used, the floor slab should not be continuous through WT 2. The cores should be sealed with mortar at the separating wall junction.

Diagram 40 FT 2 Floating layer on concrete base with ceiling under –
Key junction details (2 of 2)
(Par. 4.7.3)

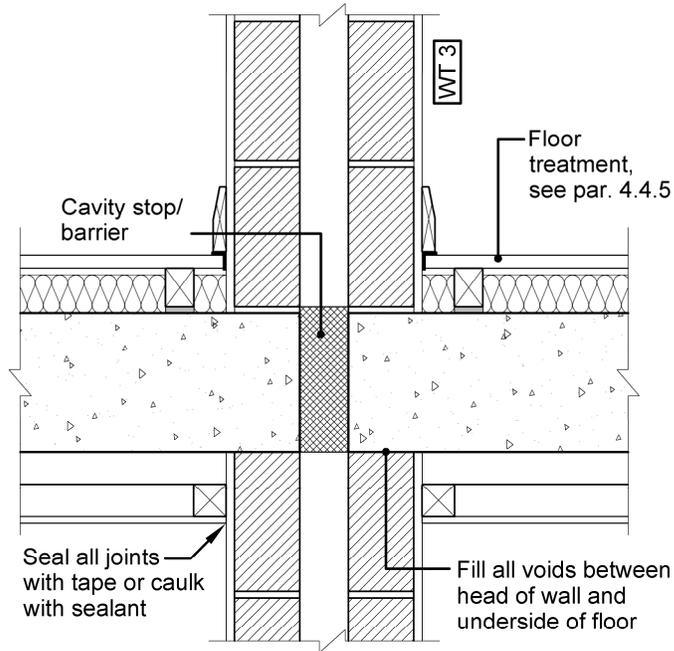


Section

**Junction between
FT 2 and WT 3**

Key Points to Watch

- The floor base should be carried through to the cavity face of the inner leaf.
- The wall cavity should not be bridged (except for wall ties).
- If hollow core planks are used, the ends of the cores should be sealed with concrete at the separating wall junction.

Diagram 41 FT 2 Floating layer on concrete base with ceiling under - Services
 (Par. 4.7.3)

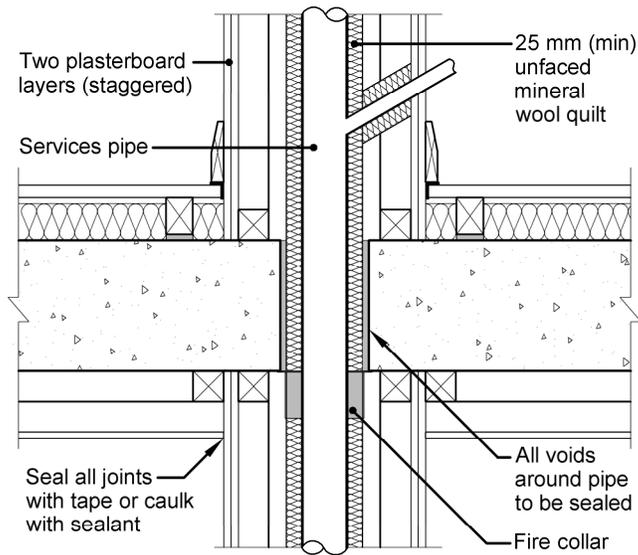

Services pipes through FT 2 (excluding gas pipes)¹

Key Points to Watch

- Fully wrap service pipe over its full height and any branches in the duct with at least 25 mm unfaced mineral wool quilt.
- The pipe should be boxed in with two layers of plasterboard, each layer to have a minimum mass of 8 kg/m² (all joints staggered).
- Penetrations through a separating floor by ducts and pipes should have fire protection to satisfy Building Regulations Part B - Fire Safety.
- Fire stopping should be flexible and also prevent rigid contact between the pipe and floor.

Section

NOTES:

1. Where gas pipes are being ducted special requirements apply. All gas services should be installed in accordance with the relevant codes and standards to ensure safe and satisfactory operation.

4.8 Floor Type 3 (FT 3) - Floating layer on timber base with ceiling under.

4.8.1 General

4.8.1.1 The resistance to airborne and impact sound depends on the mass per unit area of the concrete base, as well as the mass per unit area and isolation of the floating layer and the ceiling. The floating layer reduces the transmission of impact sound to the base and to the surrounding construction.

4.8.1.2 Timber frame dwellings should comply with the requirements of Irish Standard I.S. 440 Timber frame construction, dwellings and other buildings.


4.8.2 Floor specification

4.8.2.1 One FT 3 construction is described in Diagram 42.

4.8.3 Key junctions and flanking details

4.8.3.1 Details of how junctions with FT 3 should be constructed to limit flanking transmission are described in Diagrams 43 to 45.

Diagram 42 FT 3 Floating layer on timber base with ceiling under – Specification
(Par. 4.8.2)

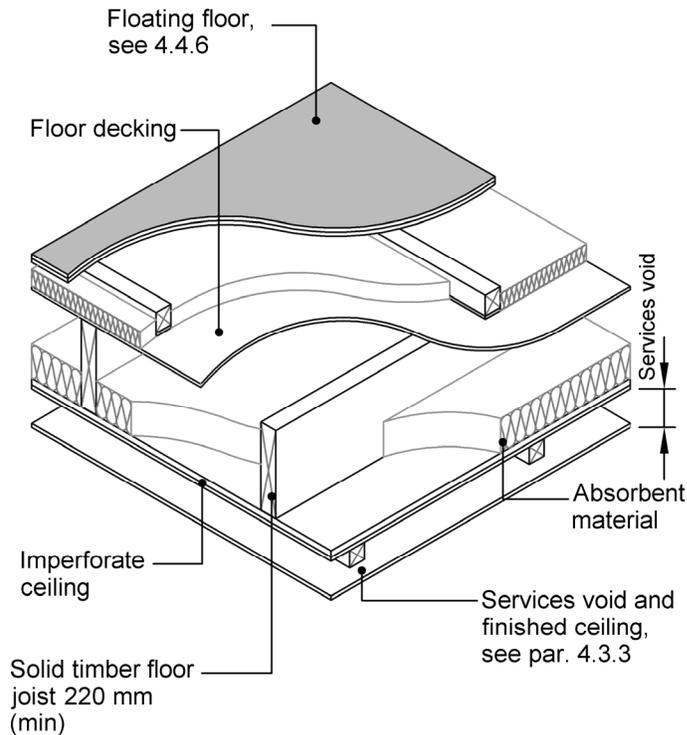

Specification

Floating floor: See par. 4.4.6 for floating floor specification.

Floor decking: 15 mm (min) wood based board, density not less than 60 kg/m³ secured to floor joists.

Joists: 220 mm (min) deep solid timber joists at 400 mm c/c (max).

Absorbent material: 100 mm (min) deep mineral wool quilt insulation (10 - 36 kg/m³) between joists.


Imperforate ceiling: 30 mm (min) thickness of plasterboard imperforate ceiling in two layers with joints staggered (to provide appropriate fire resistance). There should be no penetrations in this layer.

Services Void and Finished Ceiling: See par. 4.3.3 for ceiling specification.

Key Points to Watch

- Ensure floating floor is installed in accordance with Diagram 30.
- Lay quilt between all joists and ensure no gaps remain.
- Stagger joints in double plasterboard ceiling and seal the outer plasterboard layer with tape or caulk with sealant along the ceiling perimeter.
- Provide a services void between the underside of double plasterboard ceiling and the finished ceiling.
- **DO NOT** penetrate the imperforate ceiling (double plasterboard ceiling) with services, where possible.
- For vertical services, see Diagram 45.

**Diagram 43 FT 3 Floating layer on timber base with ceiling under –
Flanking requirements**
(Par. 4.8.3)

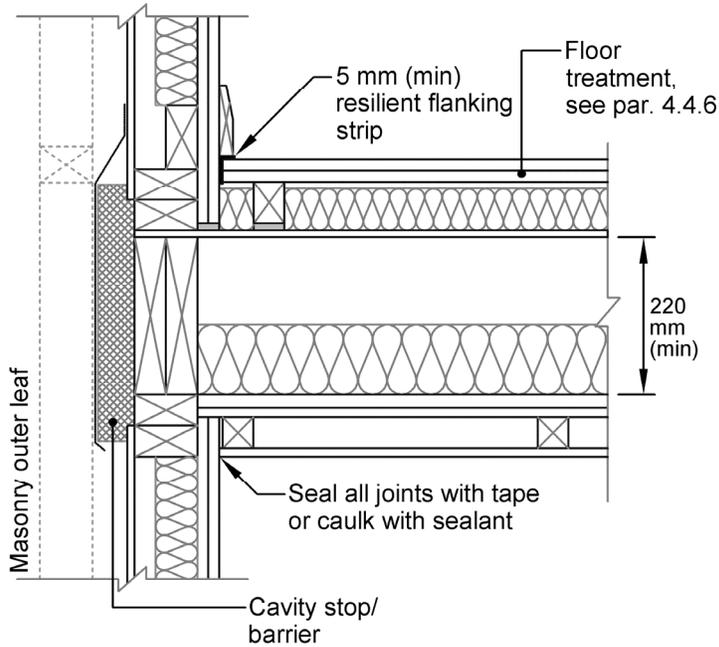

Section

Flanking wall requirements

- a) The wall finish on the flanking wall should consist of two layers of plasterboard (staggered joints). Each layer should have a mass per unit area of 10 kg/m² (min).
- b) Provide mineral wool insulation, 10 kg/m³ (min) in the flanking wall.


External wall requirements

- c) the outer leaf should be 100 mm (min) thick masonry.
- d) the cavity should be 50 mm (min).
- e) the cavity should be stopped between the ends of the separating wall and the outer leaf with a flexible cavity barrier.


Key Points to Watch

- Close spaces between the floor joists with full depth timber blocking or continuous header joist where joists are at right angles to the wall.
- Ensure that all cavity barriers are flexible and are fixed to one frame only.
- Seal all perimeter joints of plasterboard with tape or caulk with sealant.

Diagram 44 FT 3 Floating layer on timber base with ceiling under – Key junction details
(Par. 4.8.3)

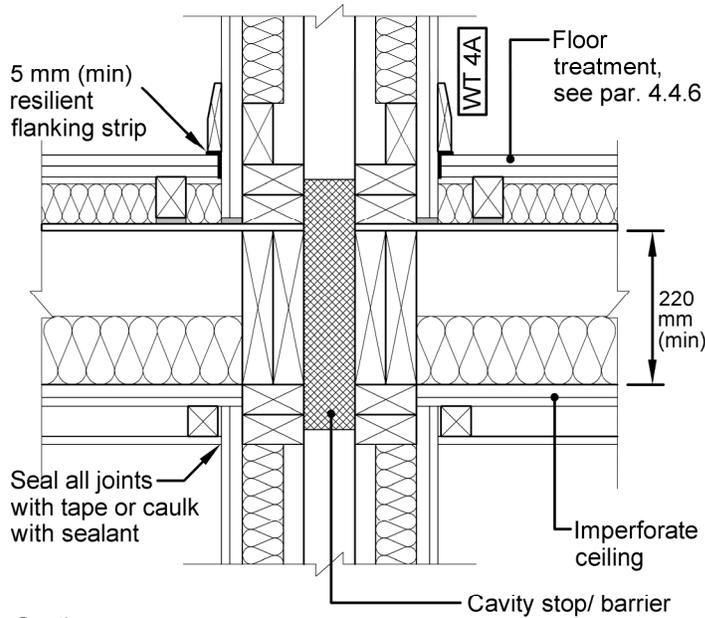

Section

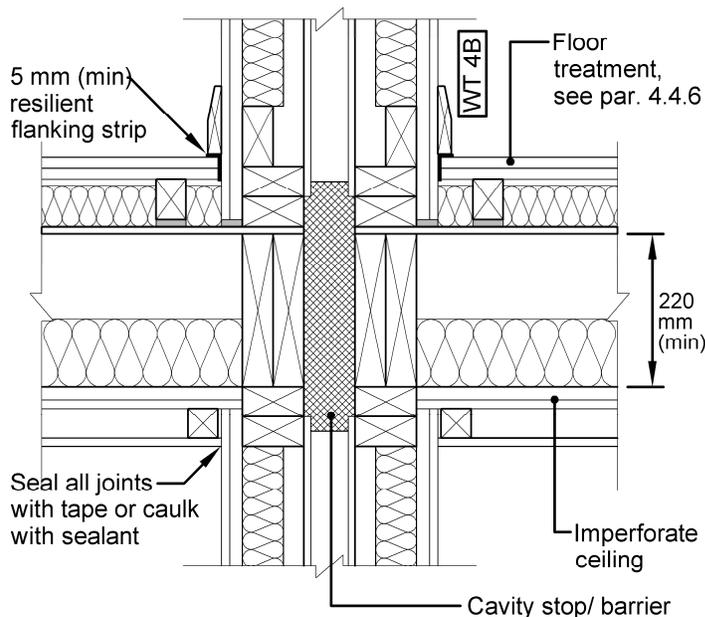


Section

A) Junction between FT 3 and WT 4 (A&B)

Key Points to Watch

- See Diagram 17 for separating wall specification.
- Close spaces between the floor joists with full depth timber blocking or continuous header joist where joists are at right angles to the wall.
- Close cavity with a cavity barrier.
- Ensure 5 mm minimum resilient flanking strip is provided adjacent to the separating wall.
- Lay quilt between all joists and ensure no gaps remain.
- Stagger joints in double plasterboard ceiling and seal the outer plasterboard layer with tape or caulk with sealant.
- Provide a services void between the underside of the imperforate ceiling and the finished ceiling.
- See Diagram 45 for vertical services.
- Seal all perimeter joints with tape or caulk with sealant.

Diagram 45 FT 3 Floating layer on timber base with ceiling under – Services
 (Par. 4.8.3)

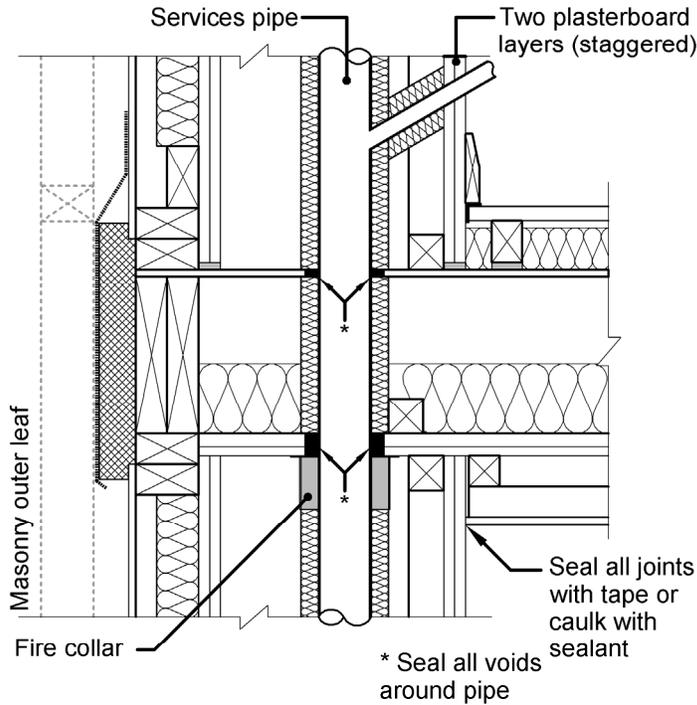

Services pipes through FT 3 (excluding gas pipes)¹

Key Points to Watch

- Fully wrap service pipe over its full height and any branches in the duct with at least 25 mm unfaced mineral wool quilt.
- The pipe should be boxed in with two layers of plasterboard, each layer to have a minimum mass of 8 kg/m² (all joints staggered).
- Penetrations through a separating floor by ducts and pipes should have fire protection to satisfy Building Regulations Part B - Fire Safety.
- Fire stopping should be flexible and also prevent rigid contact between the pipe and floor.

Section

NOTES:

1. Where gas pipes are being ducted special requirements apply. All gas services should be installed in accordance with the relevant codes and standards to ensure safe and satisfactory operation.

Section 5

Reverberation control

5.1 Reverberation control

5.1.1 General

5.1.1.1 The purpose of the requirement of Regulation E2 is to protect residents from noise produced from reverberation in common internal areas outside the dwellings. This section provides guidance on how to limit the amount of reverberation around the common spaces to a level that is reasonable in order to demonstrate compliance with the requirement of Regulation E2.

5.1.2 Common spaces

5.1.2.1 The common parts of buildings tend to be constructed with hard durable surface finishes, which are easily maintained. Unfortunately, such surfaces lack the soft open texture which efficiently absorbs sound and so the level of reflected, or reverberated, sound tends to be high in such places and can lead to an unreasonable level of noise for the occupants of dwellings which open directly onto these common spaces.

5.1.2.2 Whilst paragraph 3.2.4 outlines the inherent acoustic weak point in a separating wall caused by entrance doors opening onto a common area of a building and addresses the acoustic performance of entrance doors, Section 5 deals with ways of reducing the reverberation level at source.

5.1.2.3 It is relatively easy to increase sound absorption and hence reduce reverberant noise levels by surface treatment with absorbent material. In general this can be achieved through the application of absorbent treatment to common areas onto which dwellings open directly⁴.

5.1.2.4 For the purposes of this section, a corridor or hallway is a space for which the ratio of the longest to the shortest floor dimension is greater than three.

5.1.2.5 For the purposes of this section, an entrance hall is a space for which the ratio of the longest to the shortest floor dimension is three or less.

5.1.2.6 Where an entrance hall, corridor, hallway or stairwell opens directly into another of these spaces, the guidance should be followed for each space individually.

5.1.2.7 Where separating walls, without doors or windows, are adjacent to common areas it would not normally be necessary to treat the common areas, assuming normal usage.

5.1.3 Choice of material

5.1.3.1 The choice of absorptive material should be of an appropriate class that has been rated according to I.S. EN ISO 11654 and should meet the requirements of Part B – Fire Safety.

5.2 Methods of satisfying the requirement of Regulation E2

5.2.1 General

5.2.1.1 There are two methods (Method A or Method B) described below that will satisfy the requirement of Regulation E2.

5.2.1.2 Method A is intended for corridors, hallways and stairwells.

5.2.1.3 Method B is intended only for corridors, hallways and entrance halls as this method is not suited to stairwells.

5.2.2 Method A

5.2.2.1 For entrance halls, corridors or hallways the absorbent material should cover an area equal to or greater than the floor area, with a Class C absorber or better, rated according to I.S. EN ISO 11654. It will normally be convenient to cover the ceiling area with the additional absorption.

5.2.2.2 For stairwells or a stair enclosure, calculate the combined area of the stair treads, the upper surface of the intermediate

⁴ The common area under consideration should be limited to the space contained by walls and doors (including fire doors) immediately outside the dwelling entrance.

landings, the upper surface of the landings (excluding the ground floor) and the ceiling area on the top floor. Either cover an area at least equal to this calculated area with a Class D absorber, or cover an area equal to at least 50% of this calculated area with a Class C absorber or better. The absorptive material should be equally distributed between all floor levels. It will normally be convenient to cover the underside of intermediate landings, the underside of the other landings, and the ceiling area on the top floor.

5.2.2.3 Method A can generally be satisfied by the use of proprietary acoustic ceilings. However, the absorptive material can be applied to any surface that faces into the space.

5.2.3 Method B

5.2.3.1 In comparison with Method A, this method takes into account the actual absorption power of the surfaces of the enclosure prior to the provision of additional absorbent material. This allows the amount of additional material which is required to be calculated and directed at the sound frequencies at which it is most needed.

5.2.3.2 In some cases Method B should allow greater flexibility in satisfying the requirement of Regulation E2 and require less additional absorption than Method A. The approach to be adopted for Method B is outlined by the worked example in Appendix B.

5.3 Report Format

5.3.1 General

5.3.1.1 Evidence that the requirement of Regulation E2 has been satisfied should be retained in the form of a report or drawing which should include the following:

- (a) a description of the enclosed space (entrance hall, corridor, stairwell etc.);
- (b) the method used to satisfy the requirement of Regulation E2, i.e. Method A or Method B;

- (c) the absorber class and the area to be covered;

- (d) plans indicating the assignment of the absorptive material in the enclosed space.

Appendix A

Procedure for sound insulation testing and reporting

A.1 Introduction

This Appendix describes the sound insulation testing procedure, and provides guidance on sound insulation test reports.

Sound insulation testing should be carried out by a competent person, possessing sufficient training, experience and knowledge in the measurement of sound insulation in buildings⁵.

A.2 Field measurement of sound insulation of separating walls and floors

The measurement instrumentation used, should have a valid, traceable certificate of calibration, and should have been verified within the past two years. The sound calibrator should be independently verified at intervals not exceeding one year.

All compliance testing should be conducted by an accredited laboratory or other body with the appropriate authorisation to perform the relevant tests and calibrations.

Sound insulation testing should be carried out in accordance with the following documents:

I.S. EN ISO 16283-1: 2014;

I.S. EN ISO 140-7: 1998⁶;

I.S. EN ISO 717-1: 2013;

I.S. EN ISO 717-2: 2013;

I.S. EN ISO 3382-2: 2008.

When calculating sound insulation test results, no rounding should occur in any calculation until required by the relevant standards listed above.

⁵ Sound insulation tests carried out by a person certified by an independent third party to carry out this work offers a way of ensuring that such certification can be relied upon.

⁶ I.S. EN ISO 16283-2 should be used, when published.

A.2.1 Airborne sound insulation testing of a separating wall or floor

The airborne sound insulation testing of a separating wall or floor should be measured in accordance with the default procedure described in I.S. EN ISO 16283-1, in the frequency range 100 Hz to 3150 Hz. The low-frequency measurement procedure should not be used.

All measurements and calculations should be carried out using one-third octave frequency bands. Performance should be rated in terms of the weighted standardized level difference, $D_{nT,w}$ in accordance with I.S. EN ISO 717-1.

A.2.2 Measurements using a single sound source

An omni-directional sound source should be used which meets the directivity requirements of Annex A of I.S. EN ISO 16283-1. For each source position, the average sound pressure level in the source and receiving rooms is measured in one-third octave bands using either fixed microphone positions (and averaging these values on an energy basis) or a moving microphone.

For the source room measurements, the difference between the average sound pressure levels in the adjacent one-third octave bands should be no more than 8 dB. If this condition is not met, the source spectrum should be adjusted and the source room measurement repeated. If the condition is met, the average sound pressure level in the receiving room, and hence a level difference, should be determined.

It is essential that all measurements made in the source and receiving rooms to determine a level difference should be made without moving the sound source or changing the output level of the sound source, once its spectrum has been achieved.

The sound source should then be moved to the next position in the source room and the above procedure repeated to determine another level difference. At least two

positions, at a minimum 1.4 metres apart, should be used with each source position also varied in height by at least 0.7 metres.

The standardised level differences, in one-third octave bands, obtained from each source position shall be inverse-energy averaged to determine the level difference, D_{nT} according to equation 6 of I.S. EN ISO 16283-1.

A.2.3 Measurements using multiple sound sources operating simultaneously

Omni-directional sound sources should be used which meets the directivity requirements of Annex A of I.S. EN ISO 16283-1. The sound sources should be driven by separate and uncorrelated signals and adjusted so that each sound source is of a similar level.

The average sound pressure level in the source and receiving rooms is measured in one-third octave bands using either fixed microphone positions (and averaging these values on an energy basis) or a moving microphone.

For the source room measurements, the difference between the average sound pressure levels in the adjacent one-third octave bands should be no more than 8 dB. If this condition is not met, the source spectrum should be adjusted and the source room measurement repeated. If the condition is met, determine the average sound pressure level in the receiving room, and hence the level difference, D as defined in I.S. EN ISO 16283-1.

A.2.4 Impact sound transmission of a separating floor

A standard tapping machine should be used in accordance with A.2.4 of I.S. EN ISO 140-7⁷. The impact sound transmission of a separating floor should be measured in accordance with the procedure described in I.S. EN ISO 140-7⁷, in the frequency range 100 Hz to 3150 Hz.

The average sound pressure level in the receiving room is measured in one-third octave bands using either fixed microphone positions (and averaging these values on an energy basis) or a moving microphone.

The standardised impact sound pressure levels, in one-third octave bands, obtained from each tapping machine position shall be energy averaged to determine the standardised impact sound pressure level L'_{nT} in accordance with I.S. EN 140-7 (equation 7 of I.S. EN ISO 16283-2, when published)

Performance should be rated in terms of the weighted standardised impact sound pressure level difference, $L'_{nT,w}$ in accordance with I.S. EN ISO 717-2.

A.2.5 Measurement of reverberation time

The reverberation time in the receiving rooms should be measured using the uninterrupted noise method or the integrated impulse response method as described in I.S. EN ISO 3382-2. At least two source positions, with a total of six decays should be used.

A.2.6 Room requirements

Test rooms should be restricted to living rooms and bedrooms where possible. Kitchens and dining rooms may be considered where this is not possible.

Test rooms should have volumes of at least 25m³. If this is not possible then the volumes

⁷ I.S. EN ISO 16283-2 should be used when published, however, the use of a rubber ball for impact testing is not recommended and the low frequency measurement procedure should not be used.

of the rooms used for testing should be noted in the test report.

In apartment buildings, the dwellings chosen for test should be representative of the various dwelling layouts.

A.2.7 Tests between rooms

Tests should be conducted in completed but unfurnished rooms.

When tests are being carried out doors and windows (including trickle vents) should be closed; kitchen units, cupboards etc., on all walls should have their doors open and be unfilled.

When measuring airborne sound insulation between a pair of rooms of unequal volume, the sound source should be in the larger room.

For separating walls, two individual tests should be carried out on any one separating wall, providing there are two pairs of valid rooms either side of the wall (e.g. in a pair of dwelling houses with living room pairs on the ground floor and bedroom pairs on the first floor), two tests can be carried out, one at ground floor and one at first floor.

For separating floors, two individual tests may be carried out on any one separating floor, providing there are two pairs of valid rooms between the floor (e.g. in a pair of flats with living rooms stacked one directly above another and bedrooms stacked one directly above another) then two tests can be carried out, living room pairs and bedroom pairs.

For separating floors, the airborne and impact tests should be treated as a set and must be carried out on the same separating floor. Therefore, the minimum number of tests must include both an airborne sound insulation test and an impact sound transmission test (e.g. 2 airborne and 2 impact tests should be carried out to make up 2 test floor constructions).

Impact sound insulation tests should be conducted on a floor without a soft covering⁸

e.g. carpet, foam backed vinyl. If a soft covering has been installed, it should be taken up. If that is not possible, at least half of the floor should be exposed and the tapping machine should be placed only on the exposed part of the floor.

In Floor Type 1 the tapping machine should be placed on the fixed resilient layer.

A.2.8 Measurement precision

Sound pressure levels should be measured to 0.1 dB precision.

Reverberation times should be measured to 0.01s precision.

A.2.9 Measurements using a moving microphone

At least two positions relating to the sound source should be used.

For measurements of reverberation time, discrete positions should be used rather than a moving microphone.

A.3 Information for inclusion in test reports

The test report should contain at least the following information, in the order listed below:

- (a) Address(es) of buildings subject to testing;
- (b) Type(s) of dwelling, i.e. dwelling house, apartment, etc;
- (c) With reference to Table 3A (or Table 3B, as appropriate), the addresses of the other dwellings on the site for which this report is also applicable.
- (d) Date(s) when testing was conducted;
- (e) Organisation/ person carrying out testing, including:
 - (i) Name and address,

⁸ A bonded resilient layer is not a soft covering.

-
- (ii) Proof of competency⁹, and
 - (iii) Name(s) of client(s).
- (f) A statement (preferably in a table) giving the following information:
- (i) Rooms used for each test within the 'set of tests'.
NOTE: *State volume of room if less than 25 m³,*
 - (ii) The measured single-number quantity ($D_{nT,w}$ for airborne sound insulation and $L'_{nT,w}$ for impact sound insulation) for each individual test within a 'set of tests',
 - (iii) Description of separating walls, external walls, separating floors, and internal walls and floors including details of materials used in their construction and finishes.
NOTE: *Where certified constructions types (see paragraph 2.3) are employed the certificate number and issuing body should also be provided.*
 - (iv) The sound insulation values that should be achieved according to the values set out in Table 1.
- (g) Brief details of test, including:
- (i) equipment used,
 - (ii) a statement that the test procedures in Appendix A have been followed,
 - (iii) results of tests shown in tabular and graphical form for third octave bands according to the relevant standards referred to in A.2, including:
 - a. single number quantities and the spectrum adaptation terms, and
 - b. the D_{nT} and L'_{nT} data from which the single quantities are calculated.
- (h) Although not specifically required, it may be useful to have a description of the building including:
 - (i) sketches showing the layout and dimensions of the rooms tested;
 - (ii) mass per unit area in kg/m² of separating walls and separating floors;
 - (iii) dimensions of any step or stagger between rooms tested;
 - (iv) dimensions and position of any windows or doors in external walls.

⁹ Sound insulation tests carried out by a person certified by an independent third party to carry out this work offers a way of ensuring that such certification can be relied on.

Appendix B

Assessed Sound Details

B.1 Introduction

This Appendix describes a method for assessing and certifying construction types which, if constructed correctly, should achieve the performance level set out in Table 1.

NOTE: *All elements incorporated into the building must comply with all parts of the Building Regulations and the following guidance assesses compliance with Part E only.*

B.2 Description of construction type

The sound insulation between walls on either side of a sound resisting wall or floor depends not only on the wall or floor specification but also on other factors, including the size and shape of the rooms.

For buildings constructed in masonry, the positions of doors and windows may also be important in reducing flanking transmission.

A report should be prepared providing a detailed description of the construction type, in addition to:

- details of materials used in construction and finishes;
- mass per unit area in kg/m² of separating walls and separating floors;
- flanking construction details.

B.3 Target performance recommendations

The performance of any construction can ultimately be let down by poor workmanship on site. It is recommended that the target sound insulation performance level of assessed construction should have a mean value of 4 dB better than the minimum values set out in Table 1.

B.4 Test sampling requirements

In order to gain a more representative sample of what sound insulation performance and

repeatability might be typical of any given construction type in practice, test data should be obtained from a range of testers and sites. Table B.1 outlines the test sampling requirements.

Table B.1 Test sampling requirements¹

Min number of individual tests ²	Min number of sites	Max number of tests per site	Min number of test bodies
30	2	16	2

NOTES:

1. Test constructions must be carried out on new dwellings on actual building sites (i.e. not laboratory testing).
2. Tests should be carried out in accordance with the procedure for sound insulation testing outlined in Appendix A of this document.
3. The flanking construction details must be the same for all tests conducted.
4. For separating floors, the airborne and impact tests should be treated as a set and must be carried out on the same separating floor. Therefore, the minimum number of tests must include both an airborne sound insulation test and an impact sound transmission test (e.g. 8 airborne and 8 impact tests should be carried out to make up 8 test floor constructions).

B.5 Competency of tester

For the purposes of this Appendix, sound insulation tests referred to in B.4 must be carried out by a competent person, possessing sufficient training, experience and knowledge of construction technology and the measurement of sound insulation in buildings¹⁰ and should be independent of the promoter of the system, e.g. builder/ manufacturer.

¹⁰ Sound insulation tests carried out by a person certified by an independent third party to carry out this work offers a way of ensuring that such certification can be relied upon.

B.6 Use of historic test data

Historic test data from field measurements of sound insulation tests (not laboratory data) may be used in part or in full to satisfy the requirements of B.4 provided that the test data:

- (a) is relevant to the same construction type and has the same flanking details;
- (b) meets the performance levels outlined in Table 1;
- (c) fulfils the sampling requirements outlined in Table B.2, and
- (d) has been established in accordance with the procedure for sound insulation testing outlined in Appendix A.

B.7 Assessment and Certification

The report referred to in B.2 and the test results in accordance with B.4, B.5 and B.6 meeting target recommendations in B.3 should be assessed by an independent approved body¹¹ e.g. the National Standards Authority of Ireland (NSAI), and certified as meeting the criteria of Appendix B.

¹¹ Accreditation of an approved body, by a member of the European cooperation for Accreditation (EA) such as the Irish National Accreditation Board (INAB) also offers a way of ensuring that such certification can be relied on.

Appendix C

Reverberation control – Method B calculation

C.1 Introduction

Method B takes into account the actual absorption power of the surfaces of the enclosure prior to the provision of additional absorbent material. This allows the amount of additional material which is required to be calculated and directed at the sound frequencies at which it is most needed. In some cases Method B should allow greater flexibility in meeting the requirement of Regulation E2 and require less additional absorption than Method A.

This Appendix demonstrates by means of a worked example the differences between Method A and B.

C.2 Technical

C.2.1 For an absorptive material of surface area S in m^2 , and sound absorption coefficient α , the absorption area A is equal to the product of S and α .

C.2.2 The total absorption area A_T in square metres is defined as the hypothetical area of a totally absorbing surface, which if it were the only absorbing element in the space would give the same reverberation time as the space under consideration.

C.2.3 For n surfaces in a space, the total absorption area A_T , can be found using the following equation.

$$A_T = \alpha S_1 + \alpha S_2 + \dots + \alpha S_n$$

C.3 Provision of absorptive material

C.3.1 For entrance halls, provide a minimum of $0.2 m^2$ total absorption area per cubic metre of the volume. The additional absorptive material should be distributed over the available surfaces.

C.3.2 For corridors and hallways, provide a minimum of $0.25 m^2$ total absorption area per cubic metre of the volume. The additional absorptive material should be distributed over one or more of the available surfaces.

C.4 Method B calculation

C.4.1 Absorption areas should be calculated for each octave band. The requirement of Regulation E2 will be satisfied when the appropriate amount of absorption area is provided for each octave band between 250 Hz and 4000 Hz inclusively.


C.4.2 Absorption coefficient data (to two decimal places) should be taken from the following:

- For specific products, use laboratory measurements of the absorption coefficient data using I.S. EN ISO 354 Acoustics - Measurement of sound absorption in a reverberation room. The measured third octave band data should be converted into practical sound absorption coefficient data α_p in octave bands, according to I.S. EN ISO 11654 Acoustics – Sound absorbers for use in buildings – Rating of sound absorption;
- For generic materials use Table C.1. This contains typical absorption coefficient data for the common materials used in buildings. This data may be supplemented by published octave band data for other generic materials.

Table C.1 Absorption coefficient data for common materials in buildings (Par. C.4.2)					
Material	Sound absorption coefficient, α in octave frequency bands (Hz)				
	250	500	1000	2000	4000
Fair-faced concrete or plastered masonry	0.01	0.01	0.02	0.02	0.03
Fair-faced brick	0.02	0.03	0.04	0.05	0.07
Painted concrete block	0.05	0.06	0.07	0.09	0.08
Windows, glass façade	0.08	0.05	0.04	0.03	0.02
Doors (timber)	0.10	0.08	0.08	0.08	0.08
Glazed tile / marble	0.01	0.01	0.01	0.02	0.02
Hard floor coverings (e.g. lino, parquet) on concrete floor	0.03	0.04	0.05	0.05	0.06
Soft floor coverings (e.g. carpet) on concrete floor	0.03	0.06	0.15	0.30	0.40
Suspended plaster or plasterboard ceiling with large air space behind	0.15	0.10	0.05	0.05	0.05

C.5 Worked Example

C.5.1 The following section describes the application of Method A and B to an entrance hall of a building (refer to Diagram C.1). Each calculation step is to be rounded to two decimal places.

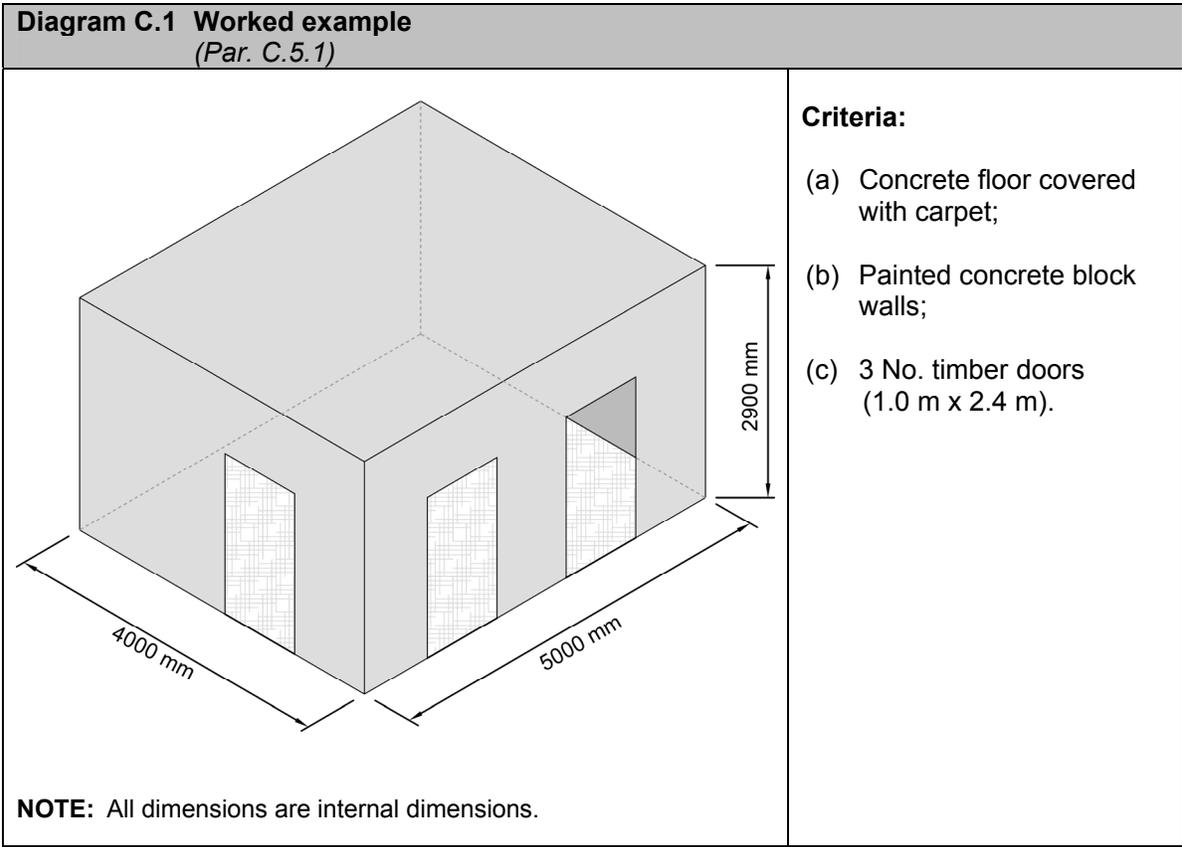

C.5.2 Application of Method A

In accordance with Method A (see paragraph 5.5.2) for entrance halls, the absorbent material should cover an area equal to or greater than the floor area, with a Class C absorber or better, rated according to I.S. EN ISO 11654.

Therefore, cover at least 20 m² (i.e. 4.0 m x 5.0 m) with a Class C absorber or better.

C.5.3 Application of Method B

Provide a minimum of 0.2 m² absorption area per cubic metre of the volume.

Calculation to Method B is described in steps 1 to 8 of Table C.2. In this example, the designer considers that covering the entire ceiling is a convenient way to provide absorption. The aim of the calculation is to determine the absorption coefficient, α_{ceiling} , needed for the entire ceiling.

In this example, the absorption coefficients from Method B indicate that a Class D absorber could be used to cover the entire ceiling. This can be compared against the slightly higher absorption requirement of Method A, which would have used a Class C absorber or better to cover the ceiling.

Table C.2 Example calculation using Method B (Par. C.5.2)						
Step 1:- Calculate the surface area related to each absorptive material (i.e. for the floor, walls, doors & ceiling).						
Surface	Surface finish					Area (m²)
Floor	Carpet covered					20
Doors	Timber					7.2
Walls (excluding door area)	Painted concrete block					45
Ceiling	To be determined from the calculation					20
Step 2 - Obtain the absorption coefficient for the carpet, painted concrete block walls and the timber doors. In this case the values are taken from Table C.1						
Surface	Area (m²)	Absorption coefficient (α) in octave frequency bands				
		250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz
Floor	20	0.03	0.06	0.15	0.30	0.40
Doors	7.2	0.10	0.08	0.08	0.08	0.08
Walls	45	0.05	0.06	0.07	0.09	0.08
Ceiling	20	To be determined from this calculation				
Step 3 - Calculate the absorption area (m ²) related to each absorptive surface (i.e. for the floor, walls and doors) in octave frequency bands. (Absorption area = surface area x absorption coefficient).						
Surface	Area (m²)	Absorption area (m²)				
		250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz
Floor	20	0.6 (20x0.03)	1.2	3.0	6.0	8.0
Doors	7.2	0.72 (7.2x0.10)	0.58	0.58	0.58	0.58
Walls	45	2.25 (45x0.05)	2.7	3.15	4.05	3.60
Step 4 - Calculate the sum of the absorption area (m ²) obtained in Step 3.						
		250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz
Existing absorption area (m ²)		3.57 (0.6+0.72+2.25)	4.48	6.73	10.63	12.18
Step 5 - Calculate the total absorption area (A _T) required for the entrance hall. (See C.3.1; Provide a minimum of 0.2 m ² absorption area per cubic metre of the volume). Therefore: A _T = 0.2 x 5 x 4 x 2.9 = 11.60 m² of absorption area required.						
Step 6 - Calculate the total absorption area (A) to be provided by ceiling (m ²). If any values of minimum absorption area are negative e.g. 4000 Hz, then, there is sufficient absorption from the existing surfaces to meet the requirement without any additional absorption in this octave band. (Additional absorption = A _T – existing absorption area (from Step 5)). N.B. negative values indicate that no additional absorption is necessary.						
		250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz
Additional absorption area (m ²)		8.03 (11.6 - 3.57)	7.12	4.87	0.97	-0.58
Step 7 - Calculate the required absorption coefficient α to be provided by ceiling. (Required absorption coefficient α = Additional absorption area/ area of ceiling).						
		250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz
Required absorption coefficient α		0.40 (8.03 ÷ 20)	0.36	0.24	0.05	Any Value
Step 8 - Identify a ceiling product from the manufacturer's laboratory measurement data that provides absorption coefficients that exceed the values in Step 7.						

Referenced standards and publications

I.S. 440: 2009+A1: 2014 Timber frame construction, dwellings and other buildings (including amendment 1, consolidated).

I.S. EN ISO 140-7: 1998 Acoustics. Measurement of sound insulation in building elements. Field measurements of impact sound insulation of floors.

NOTE: I.S. EN ISO 16283-2: XXXX will supersede I.S. EN ISO 140-7: 1998, when published.

I.S. EN ISO 354: 2003 Acoustics - Measurement of sound absorption in a reverberation room.

I.S. EN ISO 717-1: 2013 Acoustics. Rating of sound insulation in buildings and of building elements. Airborne sound insulation.

I.S. EN ISO 717-2: 2013 Acoustics. Rating of sound insulation in buildings and of building elements. Impact sound insulation.

I.S. EN ISO 3382-2: 2008 Acoustics – Measurement of room acoustic parameters – Part 2: Reverberation time in ordinary rooms.

I.S. EN ISO 10140: 2010 Acoustics - Laboratory measurement of sound insulation of building elements (Part 1 to 5).

I.S. EN ISO 11654: 1997 Acoustics - Sound absorbers for use in buildings - Rating of sound absorption.

I.S. EN 29052-1: 1993 Acoustics – Determination of dynamic stiffness – Part 1: Materials used under floating floors in dwellings.

I.S. EN ISO 16283-1: 2014 Acoustics – Field measurement of sound insulation in buildings and of building elements – Part 1: Airborne sound insulation.

I.S. EN ISO 16283-2: XXXX Acoustics – Field measurement of sound insulation in buildings and of building elements – Part 2: Impact sound insulation.

BS 8233: 2014 Guidance on sound insulation and noise reduction for buildings.

BRE Information Paper IP 9/88 Methods for reducing impact sounds in buildings.

Other standards and publications

Housing and Sound Insulation – Improving existing attached dwellings and designing for conversions - Building Performance Centre, Napier University 2006.

I.S. EN ISO 24340: 2012 Resilient Floor Coverings - Determination of the Thickness of Layers (ISO 24340:2006).

ISBN 978-1-4064-2872-8



9 781406 428728



Printed on recycled paper containing a minimum of 75% post-consumer waste