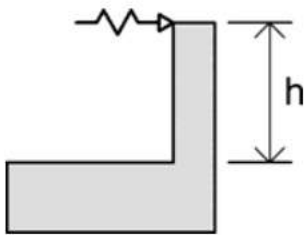
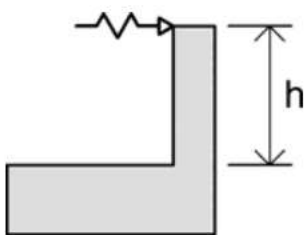
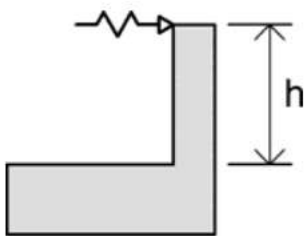
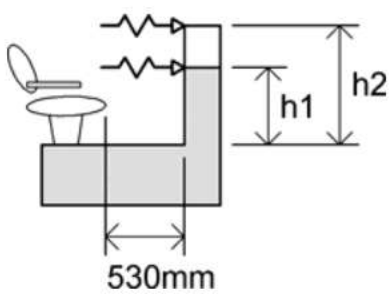
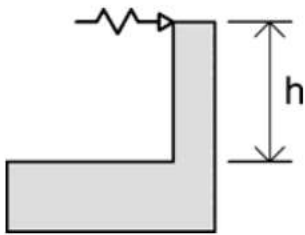


Diagram 6 Guarding design
Par. 1.1.20

Building and location		Strength	Height (h)	
Single family dwellings	Stairway, ramp, landing	Refer to I.S. EN 1991-1-1 ¹	900 mm for all elements	
	Floor, balcony, roof		1100 mm	
Factories and warehouses (light traffic)	Stairway, ramp	Refer to I.S. EN 1991-1-1 ¹	900 mm	
	Landings and edges of floor		1100 mm	
Other residential, institutional, educational, office and public buildings	All locations	Refer to I.S. EN 1991-1-1 ¹	900 mm for flights, elsewhere 1100 mm	
Place of assembly	Within 530 mm in front of fixed seating	Refer to I.S. EN 1991-1-1 ¹	800 mm (h1)	
	All other locations		900 mm for flights, elsewhere 1100 mm (h2)	
Retail shop	All locations	Refer to I.S. EN 1991-1-1 ¹	900 mm for flights, elsewhere 1100 mm	

Note:

1. together with the Irish National Annex (taking into account the recommendations of NA.4, as necessary)