


## Diagram 11 Foundation dimensions (Par. 1.1.5.2)

The minimum thickness of the foundation ( $T$ ) should either be  $P$  or 200mm, whichever is greater.

$W$  = Wall thickness

**Note:** Backfill material should be in accordance with Technical Guidance Document C (Site Preparation and Resistance to Moisture)

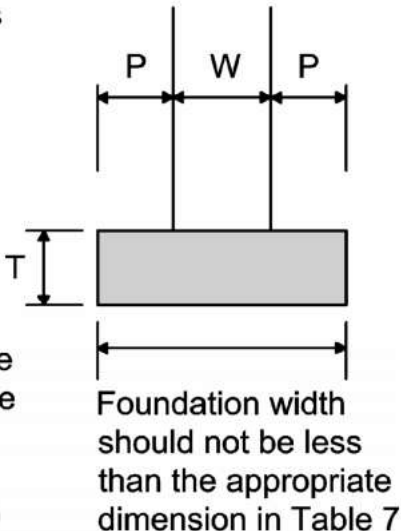

**Strip Foundation**