


Diagram 32 Fire appliance (high reach) access to buildings

Par. 5.2.4

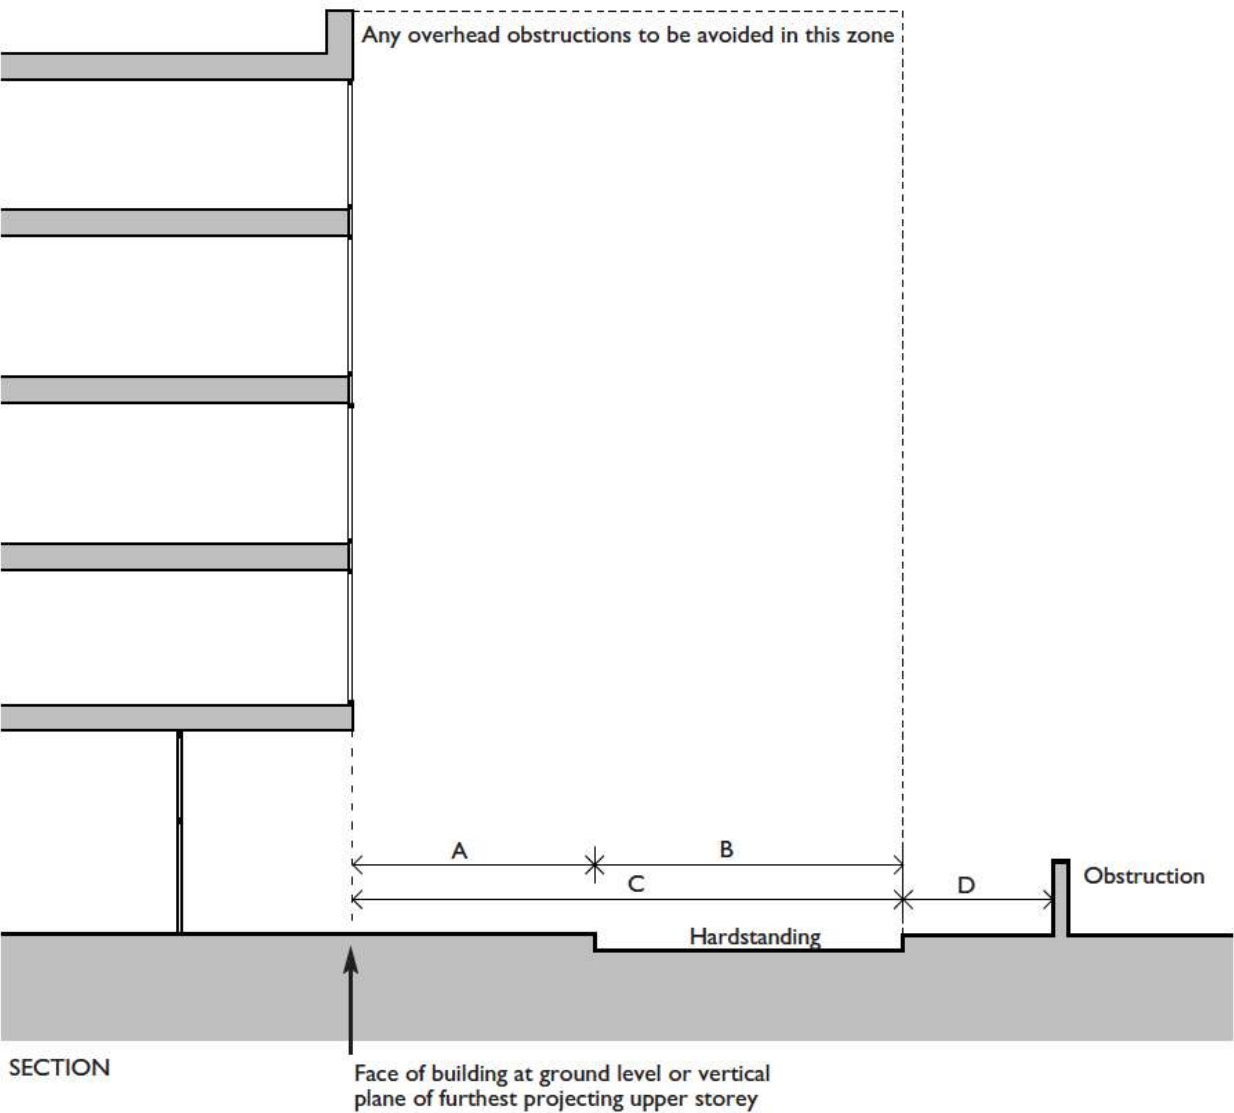

DIMENSION	TYPE OF APPLIANCE	
	Turntable ladder	Hydraulic platform
A Max distance of hardstanding from building	4.9 m	2.0 m
B Minimum width of hardstanding	5.0 m	5.5 m
C Minimum distance of further edge of hardstanding	10 m	7.5 m
D Minimum width of unobstructed space for swing of hydraulic platform	n/a	2.2 m

NOTE
Hardstanding for high reach appliances should be as level as possible and should not exceed a gradient of 1 in 12.